

FIDES DAYLIGHTING INTEGRATION BUILDING MANAGEMENT

Disruptive Innovation

Standby zero with advanced interaction dimming for building managements system
Tangible benefits for Reliability, maintain free, wire free, easy to access by web

COPYRIGHT

This document was written by Jeong Yeonmoon. All rights reserved. No part of this publication may be reproduced, or transmitted in any form by any means, electronic, mechanical, photocopying, recording or otherwise, with out prior permission of Jeong Yeonmoon.

Jeong.osc@gmail.com

Tel : 82-10-3343-0318

SPECIAL CONSIDERATIONS

Standby power, also called **vampire power**, **vampire draw**, **phantom load**, or **leaking electricity** ("phantom load" and "**leaking electricity**" are defined technical terms with other meanings, adopted for this different purpose), refers to the **electric power** consumed by electronic and electrical appliances while they are switched off (but are designed to draw some power) or in a **standby mode**. This only occurs because some devices claimed to be "switched off" on the electronic interface, but are in a different state from switching off from the plug, or disconnecting from the plug, which can solve the problem of standby power completely. In fact, switching off at the plug is effective enough, there is no need to disconnect all devices from the plug. Some such devices offer **remote controls** and **digital clock** features to the user, while other devices, such as **power adapters** for disconnected electronic devices, consume power without offering any features (sometimes called **no-load power**). All of the above examples, such as the remote control, digital clock functions and, in the case of adapters, no-load power, are switched off just by switching off at the plug. However, for some devices with built-in internal battery, such as the phone, the standby functions can be stopped by removing the battery instead. In the past standby power was largely a non-issue for users, electricity providers, manufacturers, and government regulators. In the first decade of the twenty-first century awareness of the issue grew and it became an important consideration for all parties. Up to the middle of the decade, standby power was often several watts or even tens of watts per appliance. By 2010 regulations were in place in most developed countries restricting standby power of devices sold to one watt (and half that from 2013).

The **One Watt Initiative** was launched by the **IEA** in 1999 to ensure through international cooperation that by 2010 all new appliances sold in the world only use one watt in standby mode. This would reduce CO₂ emissions by 50 million tons in the OECD countries alone by 2010.

In July 2001 **U.S.** President **George W. Bush** signed an **Executive Order** directing federal agencies to "purchase products that use no more than one watt in their standby power consuming mode".^[12]

In July 2007 California's 2005 appliance standards came into effect, limiting external power supply standby power to 0.5 watts.^[13]

On 6 January 2010 the **European Commission** (EC) Regulation No 1275/2008 came into force. The regulations mandate that from 6 January 2010 "off mode" and standby power for electrical and electronic household and office equipment shall not exceed 1W, "standby plus" power (providing information or status display in addition to possible reactivation function) shall not exceed 2W. Equipment must where appropriate provide off mode and/or standby mode when the equipment is connected to the mains power source. These figures were halved on 6 January 2013.^[14]

MORE...

Now a day, realization of building management needs to daylight energy reduce and the some of sensing by low costs network system with substitution mechanical power switch for standby zero supports.

FIDES-Dimmer are only one of solution of efficiency by full of requirements building managements system.

Such as mechanical switches substitution to epoch-making novel standby zero circuits theory with flicker free constant voltage drive dimming technology employed.

This technology can provide ideally makes very good cost effect an flicker free dimming with no data wire and AC switch for LED luminaire.

Operational Benefits


When a general lighting system try to dimming by ambient sensor. So, it could not provide dimming pleasant environment. This is approached in different ways. The daylight dimming can interactively reaction at any vicinity lighting environments to individually. Accurate execution on price quotes, and on-time, precise billing with avoid the blackout.

In addition to standby zero efficiency benefits are killed all data lines and switches to makes a saving install fees. With the just plugging AC line installations makes easy to old building transformation to energy efficiency Building Automation System building.

ARRA Section 1605 establishes requirements for federal government projects funded with stimulus monies: "None of the funds appropriated or otherwise made available by [the ARRA] may be used for a project for the construction, alteration, maintenance, or repair of a public building or public work unless all of the iron, steel, and manufactured goods used in the project are produced in the United States." Iron and steel used as components or subcomponents of other manufactured construction materials do not need to be produced in the United States. There is no requirement that components and subcomponents be U.S.-origin provided the manufactured construction material is "produced in the United States." (FAR 25.001(c)(4)) Section 1605 does not contain a domestic cost requirement. However, the government has not defined "produced" for purposes of the ARRA Buy American provision. Many commentators have adopted the "substantial transformation" test to determine whether a manufactured article is "produced" in the United States for purposes of Section 1605. Section 1605 contains a requirement that the Buy American provision be applied in a manner consistent with U.S. obligations under international agreements. As a result, national treatment is extended to products from countries with which the United States has entered a free trade agreement (e.g., Canada, Mexico, Bahrain, Chile, etc.) and to products from countries that have signed the WTO Government Procurement Agreement. National treatment is also extended to least developed countries (LDCs) (e.g., Bhutan, Mali, Zambia, etc.) but not to Caribbean basin countries (e.g., Belize, Haiti, Bahamas, etc.)

Share of LED lighting market


Market Share by Region, 2010

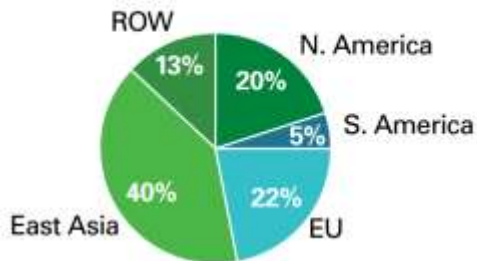

- Global LED Lighting market to reach \$16.5B in 2012, 11.3% share of total lighting
- 60% Comm'l, 25% Resdl, 15% Indl/Instl
- Key luminaire drivers: traffic lights, roadways, parking lots, and other outdoors

LED share of lighting market to exceed 25% by 2014

LED Lighting Market Value, 2009–2014 (US\$B)

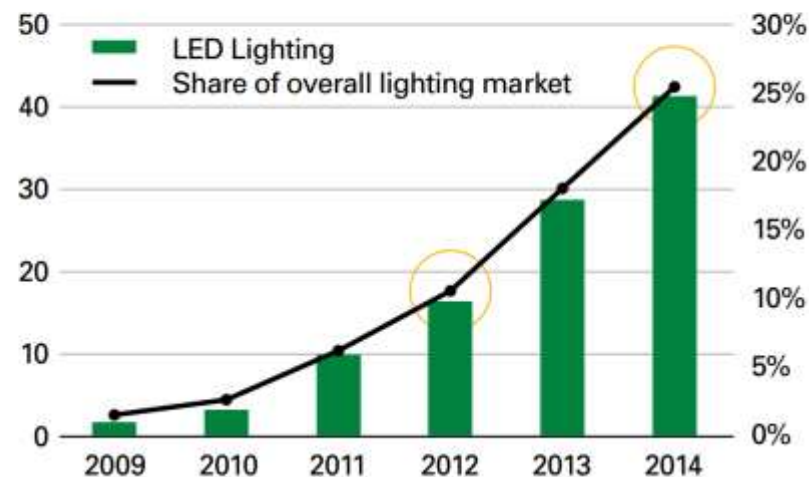

The first LED lamps were introduced in the late 1990s. Since then, the unit costs have been steadily declining by double-digit percentages, making LED lighting technology viable for commercial, industrial and outdoor lighting applications. In addition, large strides have been made in improving the efficiency, lumen output and performance of LED lights. The global LED lighting market is estimated to be \$16B in 2012 and expected to reach nearly \$40B by 2014 (Figure 1). The US market CAGR for commercial and outdoor LED lighting alone is expected to grow 26-30% through 2016.

NEW LIGHTING STANDARDS



Lighting Facts Per Bulb	
Brightness	800 lumens
Estimated Yearly Energy Cost \$1.57	
<small>Based on 3 hrs/day, 11 c/kWh</small>	
<small>Cost depends on rates and use</small>	
Life	9 years
<small>Based on 3 hrs/day</small>	
Light Appearance	
<div> <div>Warm</div> <div>2700 K</div> <div>Cool</div> </div>	
Energy Used	13 watts



25% more energy efficient ; Security Act of 2007 (EISA 2007)

FIDES BUILDING MANAGEMENT SYSTEM



Energy Administration



Building Equipment
Integration



Zone Control



User Friendly Interface



Remote Control and
Alarm, SMS



BACnet, LonWorks, Modbus, OPC
Open Protocol Support

Why Lighting is an Energy Issue


Lighting in all segments (residential, commercial, industrial, and outdoor) consumes almost 25% of the energy in the built environment, internationally. ¹

This energy is expended both in the electricity necessary to illuminate a given lightbulb, but also in cooling costs needed to counteract the heat produced by lighting fixtures. In fact, the heat produced by lighting alone contributes to 42% of the cooling load in U.S. buildings.²

The energy used by lighting amounts to 1.2 Terawatts (equivalent to 1,200 Gigawatts or 1,200,000 Megawatts), 112 full-sized power plants, and 1.9 billion tons of annual carbon emissions.³

If LEDs made up 45% of the world's lighting supply by 2020, we would forgo 5 trillion kWh of electricity, 559 full-sized power plants, and 8.4 billion tons of carbon emissions.⁴

U.S Commercial building electricity use

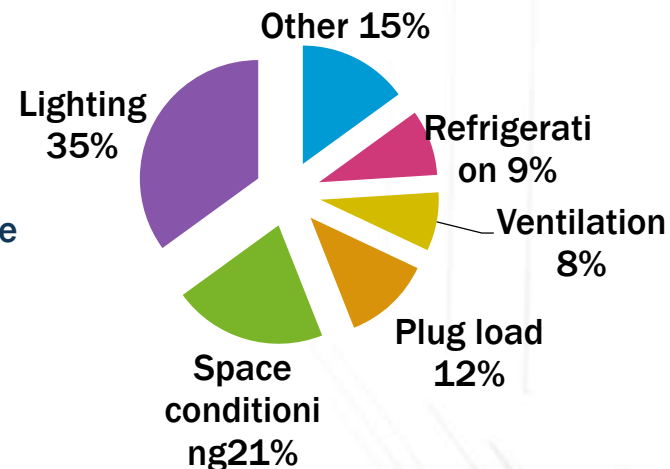

¹ <http://www.undp.org.cn/projects/00062179.pdf>


² U.S. Department of Energy Buildings Energy Data Book, Sept. 2008

³ Based on United States Energy Information Administration estimates.

⁴ Ibid.

Power Consumption of BMS :

Standby zero, Daylight dimming

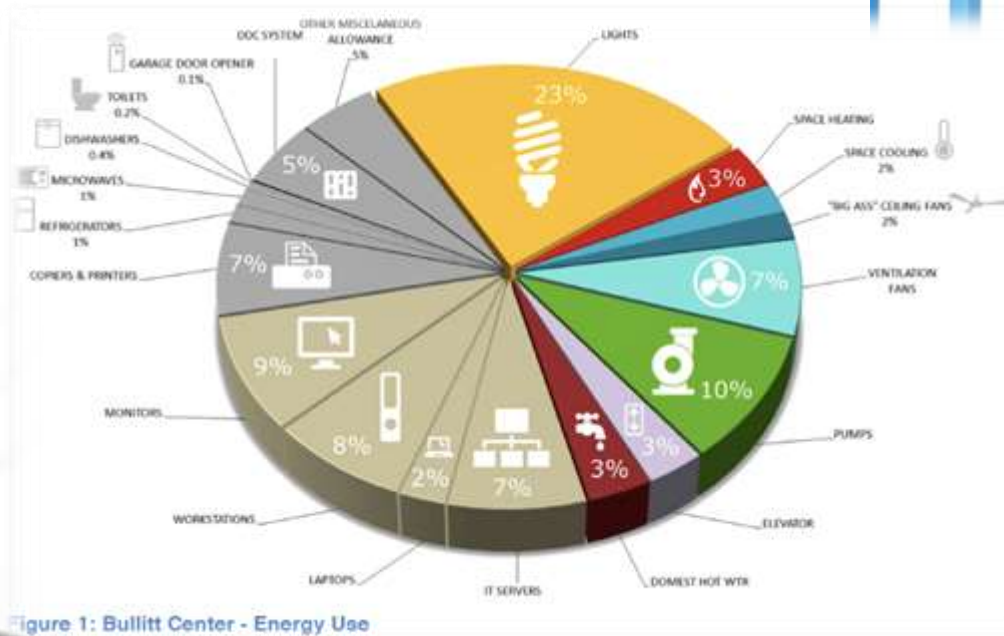

American Reconstruction and Reinvestment Act of 2009

FIDES : STANDBY Energy Saving

STANDBY POWER MEASUREMENT RESULTS

12W LOAD	120V	220V
STANDBY	0.027W	0.027W
ON(LOAD)	12W	12W
200W LOAD	120V	220V
STANDBY	0.027W	0.027W
ON(LOAD)	200W	200W

Any load power participate are same for stand by power keep in under the 0.027W, during the first initializing plugged to AC line for few seconds to a few watts to charging for super capacitor. After it's only allowed leakage currents in traic switching driver circuits.

Power Consumption*1 - When the power is off: Any load equipment approximately 100V at 0.027 W *1*2*3 / At 220V approx 0.03 W *1*2

*1: Power consumption not varies. depending on the input voltage environment.

*2: Measured according to IEC 62301 Edition 2.0.

*3: Even when the machine is turned off, it will automatically turn itself on periodically for re charging maintenance, and then turn itself off.

Example of standby power consumption : 1W/h standby power SMPS X 1K pcs in building = 1KW/h
(Standby at 14h/day for year \approx 0.5MW/years

Same condition at Fides standby power consumption = 138W/years (0.5MW electric energy save!)

* IEC 62301 in large appliances manufacturers target <50 mW or '0.0W consumption'

FIDES DIMMER Vs ORDINARY DIMMER

	DALI	RF WIRELESS	FIDES
COSTS	✗	▲	😊
INSTALLATION	✗	✗	😊
STANDBY ZERO	✗	✗	😊
ADVANCED INTERACTION DIMMING	✗	▲	😊
CONNECTIVITY	✗	😊	😊
POWER CONSUMPTION	✗	✗	😊
AC POWER MEASUREMENT	✗	😊	😊
SMART GRID	✗	😊	😊
MULTI-SENSOR	✗	😊	😊
WEB CONTROL	▲	😊	😊



VERY GOOD



NOT GOOD



BAD

FIDES MERIT IS REAL INTERNET OF THINGS


FIDES BMS; disruption to ordinary BMS technologies chain.

	Ordinary BMS system	FIDES BMS system
IEC62031 Standby Zero	Not supports	Patent Technology
Individual dimmer	High Price	Good Price(Patent Pending)
Wire	Complicate	Just Plug AC Line
Temp, Humidity, Ambient	Option	Integrated
AC Power Line measure	Option	Integrated
Luminaire connection Limit	Limit	Unlimited
Fire alarm, Occupy Sensor	Option	Option(Just Plug in AP)
Management Software	Option	Default


* For more information refer to FIDES_ADSZ data sheet manual.

SIMPLE WIRE ARCHITECTURE


SIMPLE FIDES WIRE

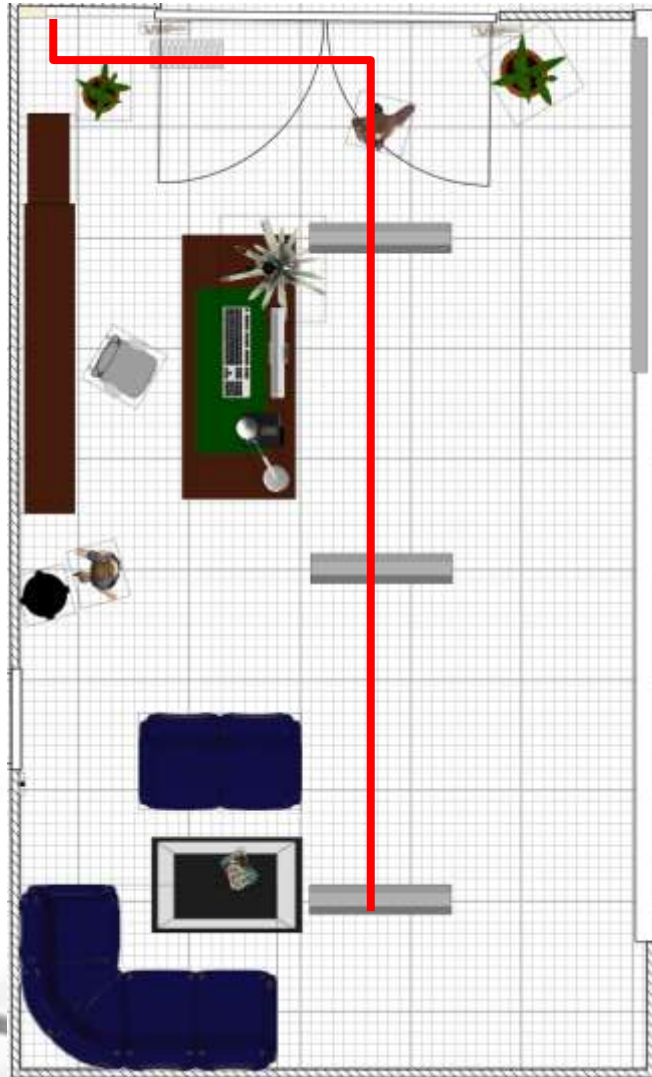

COMPLICATE DALI WIRE

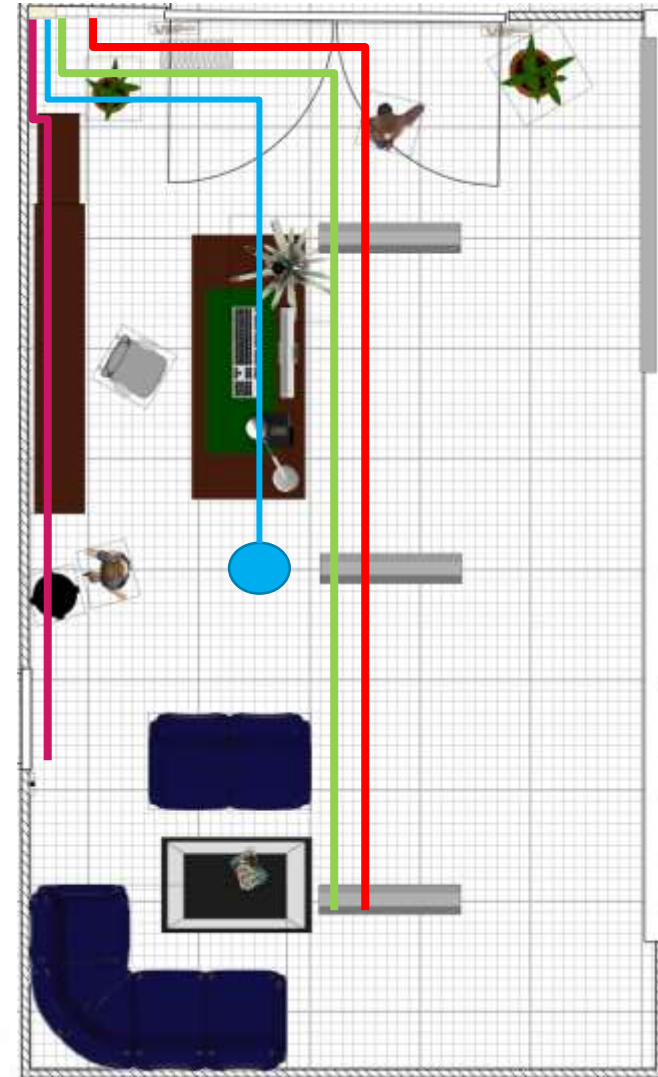

TYPICAL BMS ARCHITECTURE

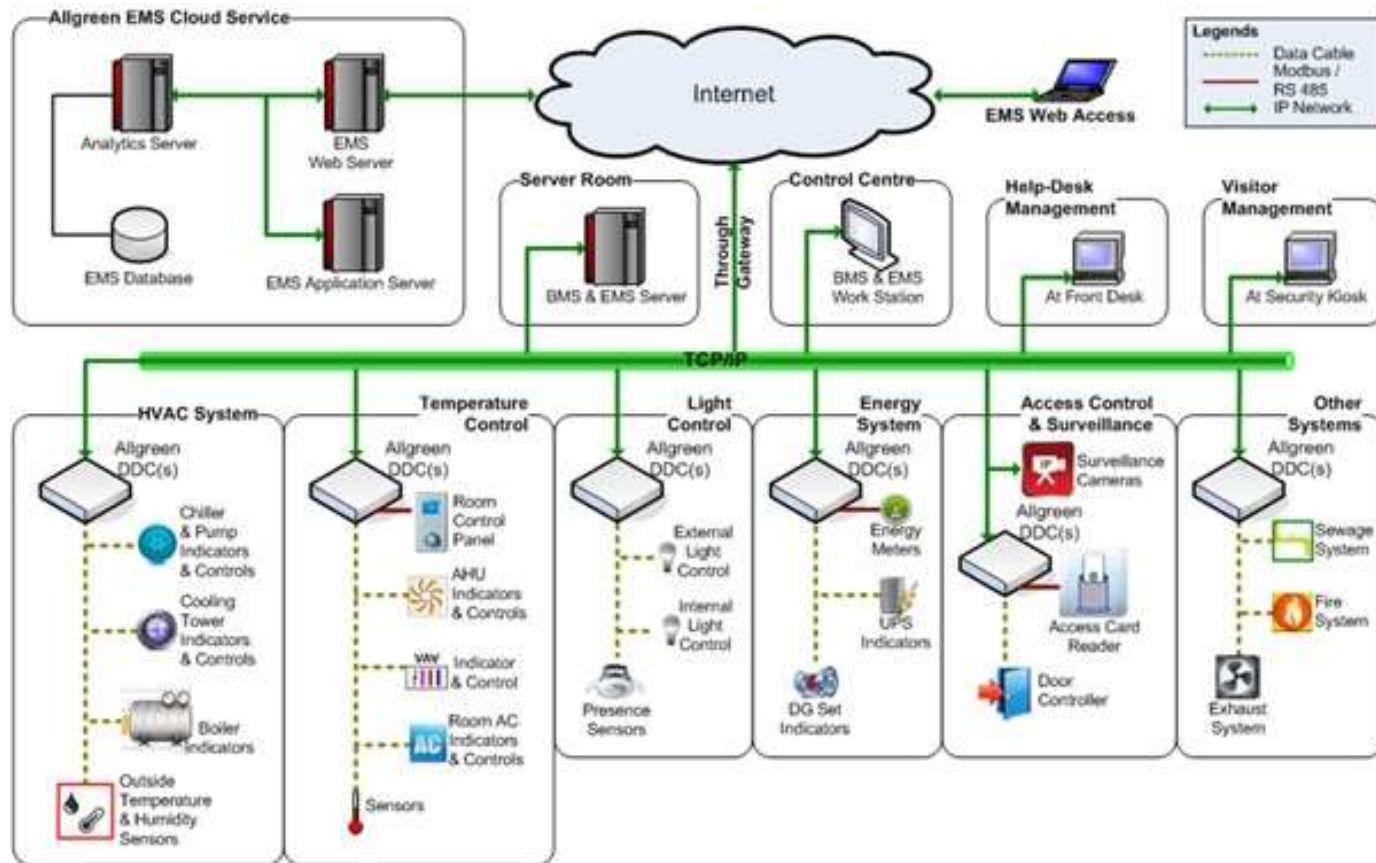

Too much complicate!

FIDES-BMS ARCHITECTURE SUCCINCT GRID NETWORKS



AC100~230V

DJ03AB



Wireless Daisy chain




DJ04,5/DJ02

Sustainable buildings





FIDES : Energy Saving

Daylight Individual Interaction Dimming

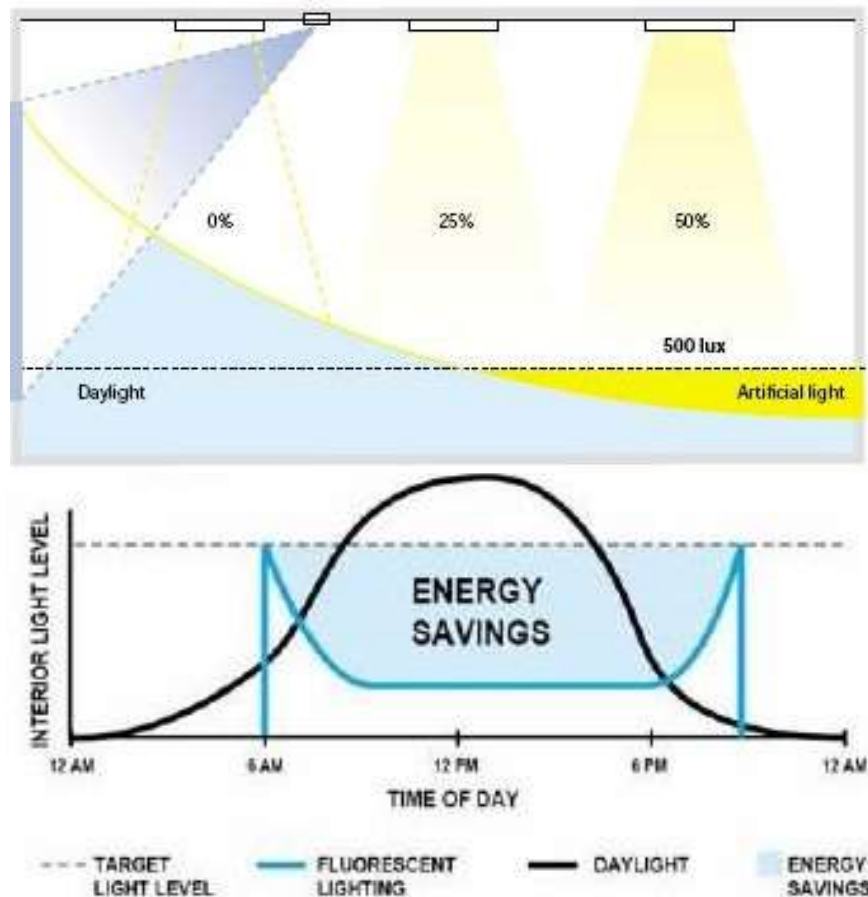


Daylight dimming

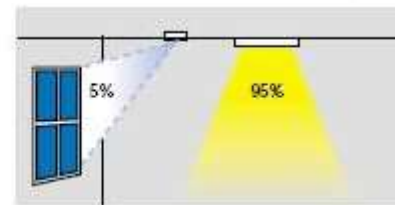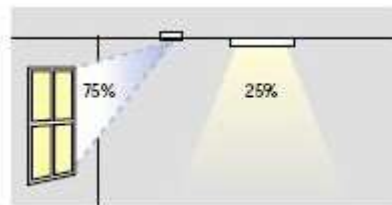


A daylight harvesting system decreases electric light contribution as the daylight contribution increases. Courtesy of Leviton.

Building management winner!

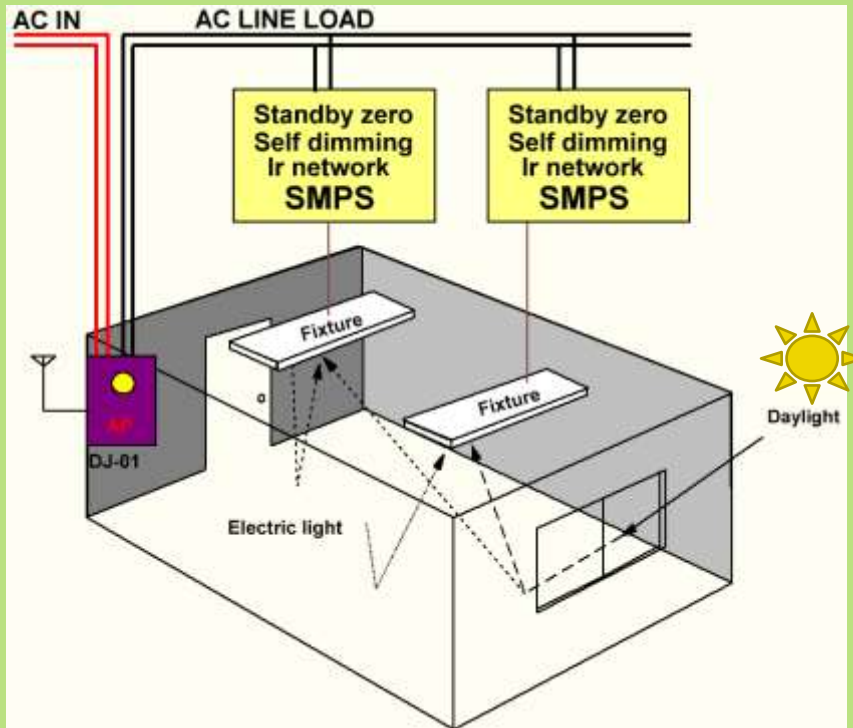

All in One Supports :

- IEC62301 Standby zero(Patent 0.035W/h)
- IEC62053-21 AC Power measurement
- Temp/Humidity/Ambient sense
- Full flicker free individual dimming
- Wire Free IrDA/2.4Ghz Smart Grid Network
- 10 years Limited Warranty

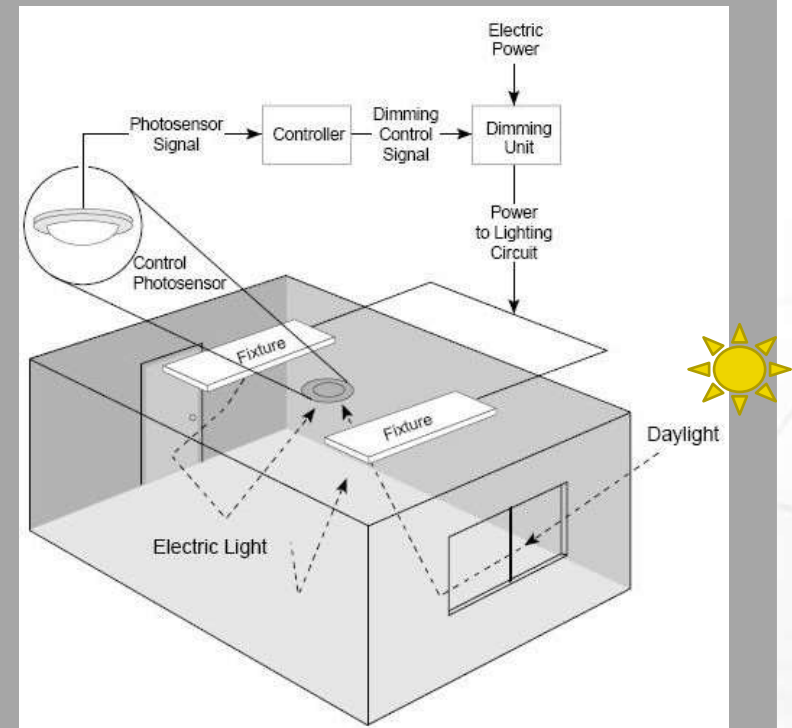


Typical daylight system

Not support :


- IEC62301 Standby zero not support
- IEC62053-21 AC Power measurement
- Temp/Humidity sense
- Full flicker free individual dimming
- No 10year warranty

Typical daylight harvesting control system.

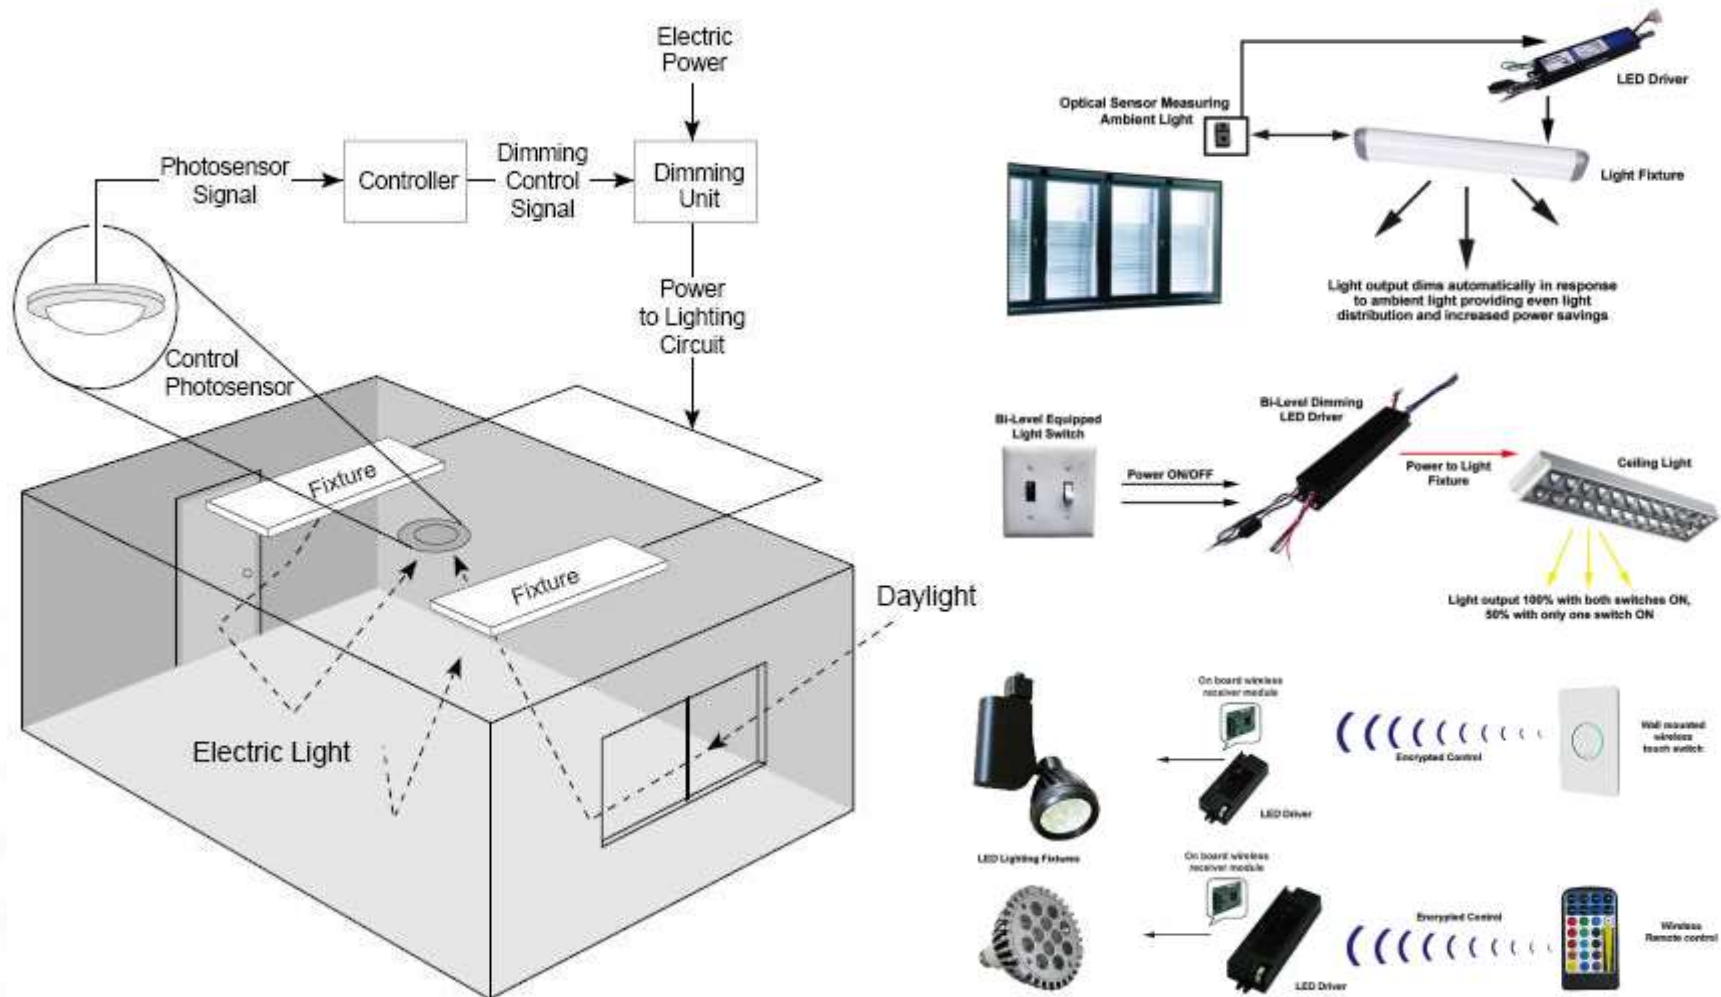


Courtesy of Lawrence Berkeley National Laboratory.


Competitors typical daylight zone control system.

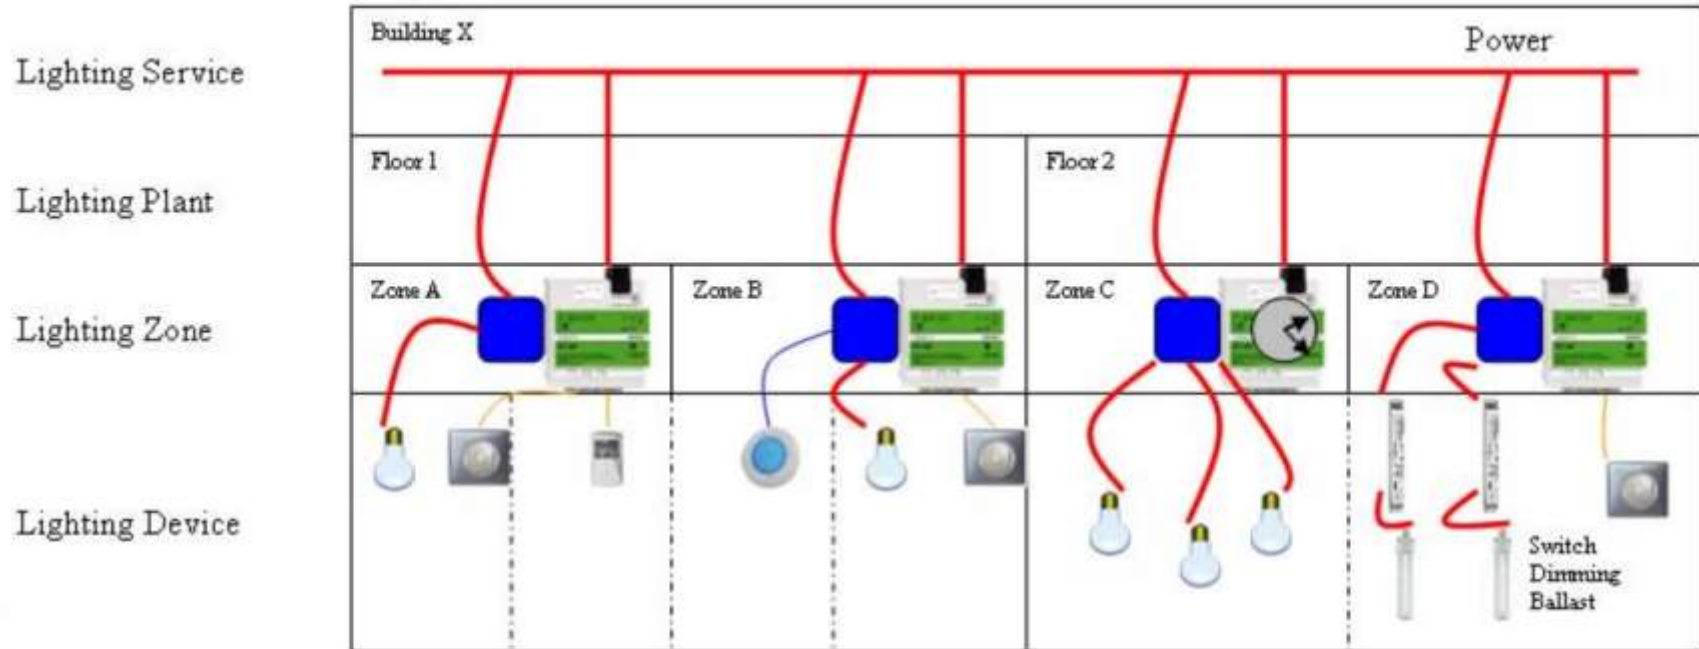

DALI dimming wire connection

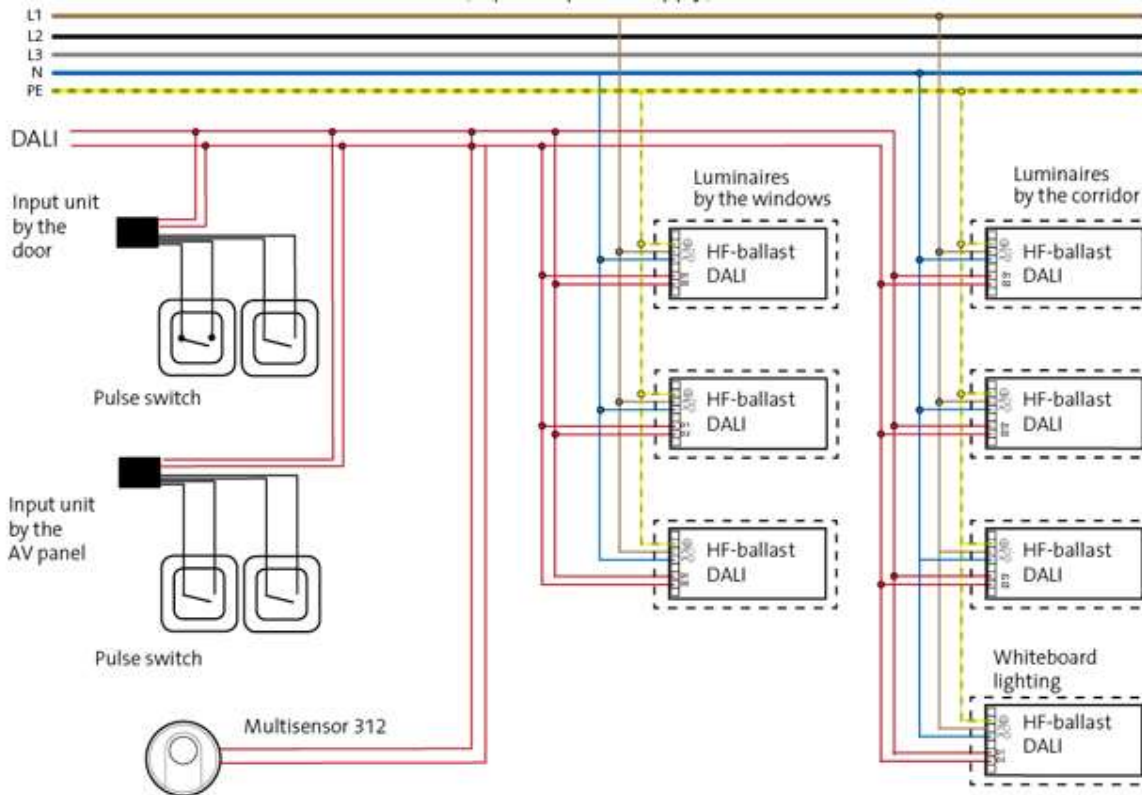


DALI BUS WIRE

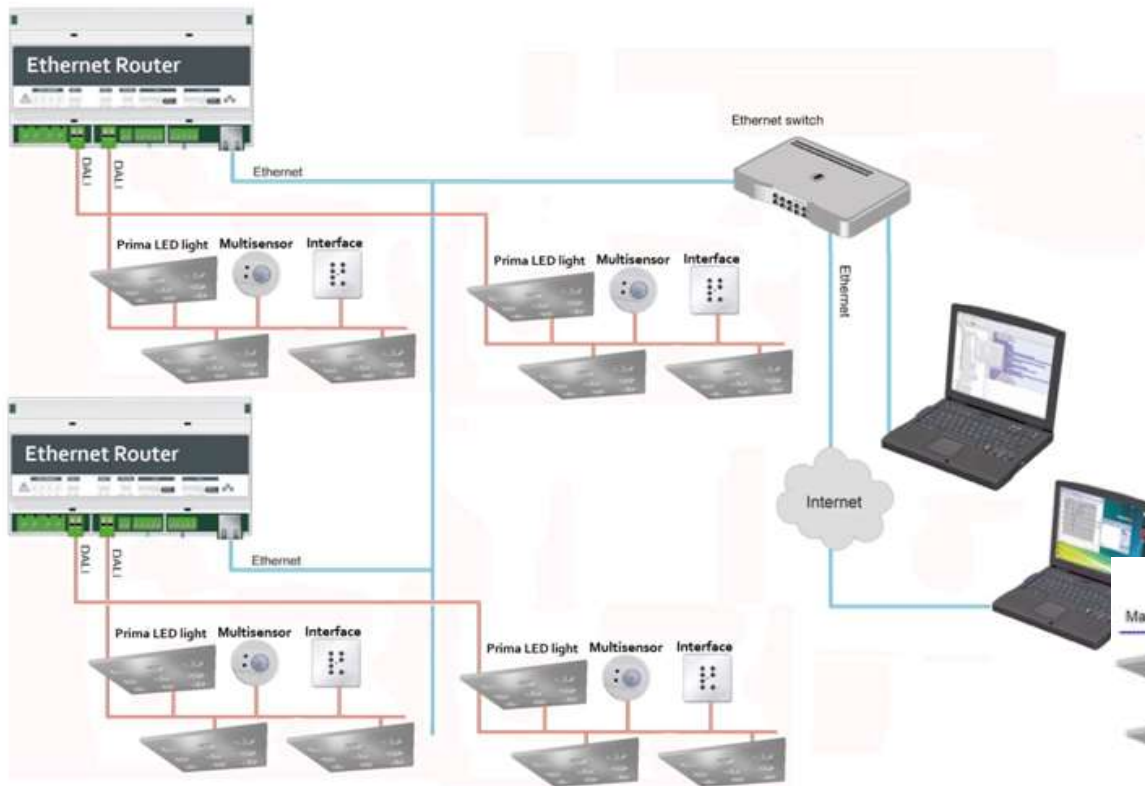


Picture 3: Large DALI system with DALI routers

Too much complicate and expansive with no efficiency energy saving architecture system

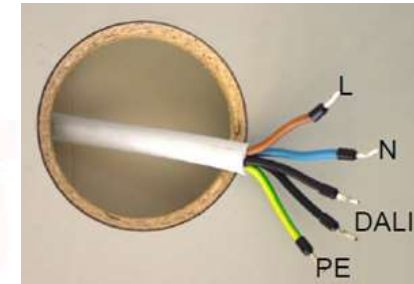


Picture 2: Standalone DALI system

KNX BMS SOLUTION ARCHITECTURE

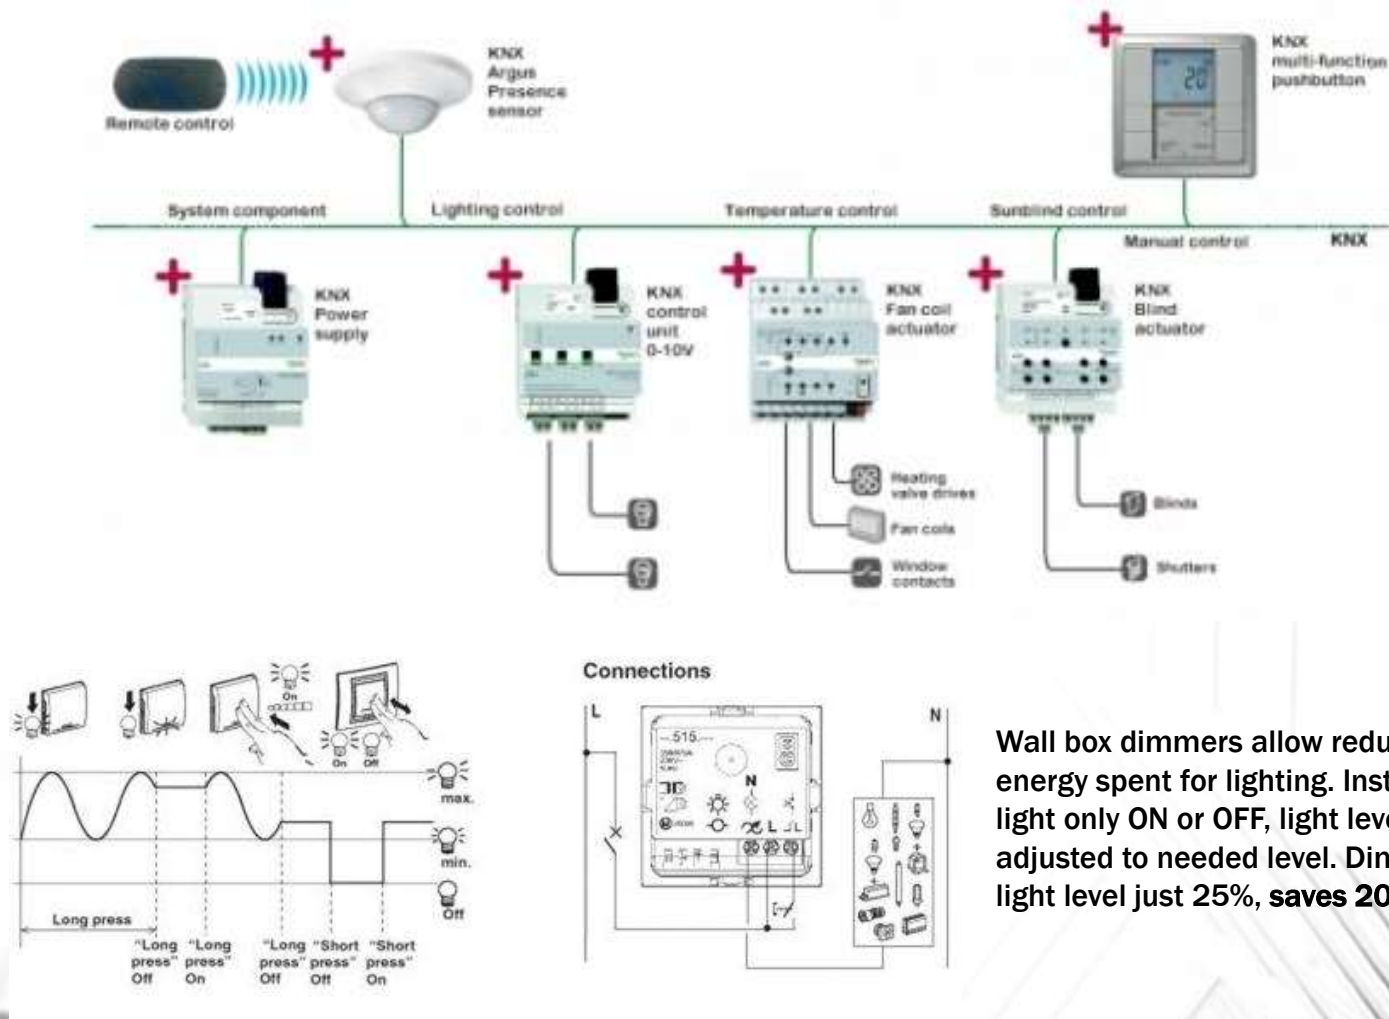


Wall box dimmers allow reduction of energy spent for lighting. Instead of having light only ON or OFF, light level can be adjusted to needed level. Dimming your light level just 25%, saves 20% in energy.

SIEMENS APOGEE BUILDING AUTOMATION

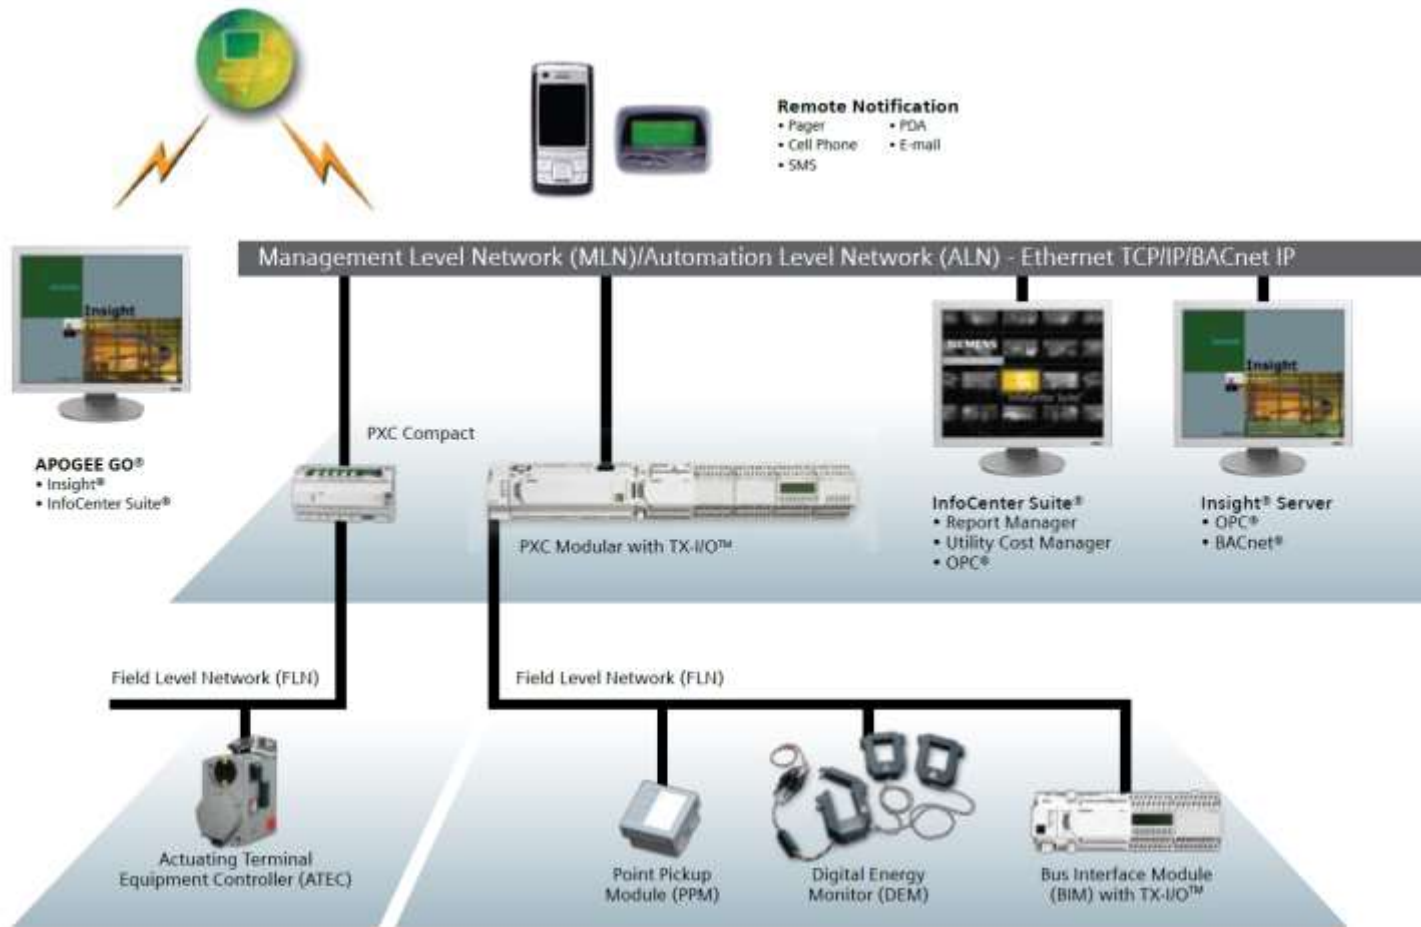

SIEMENS APOGEE

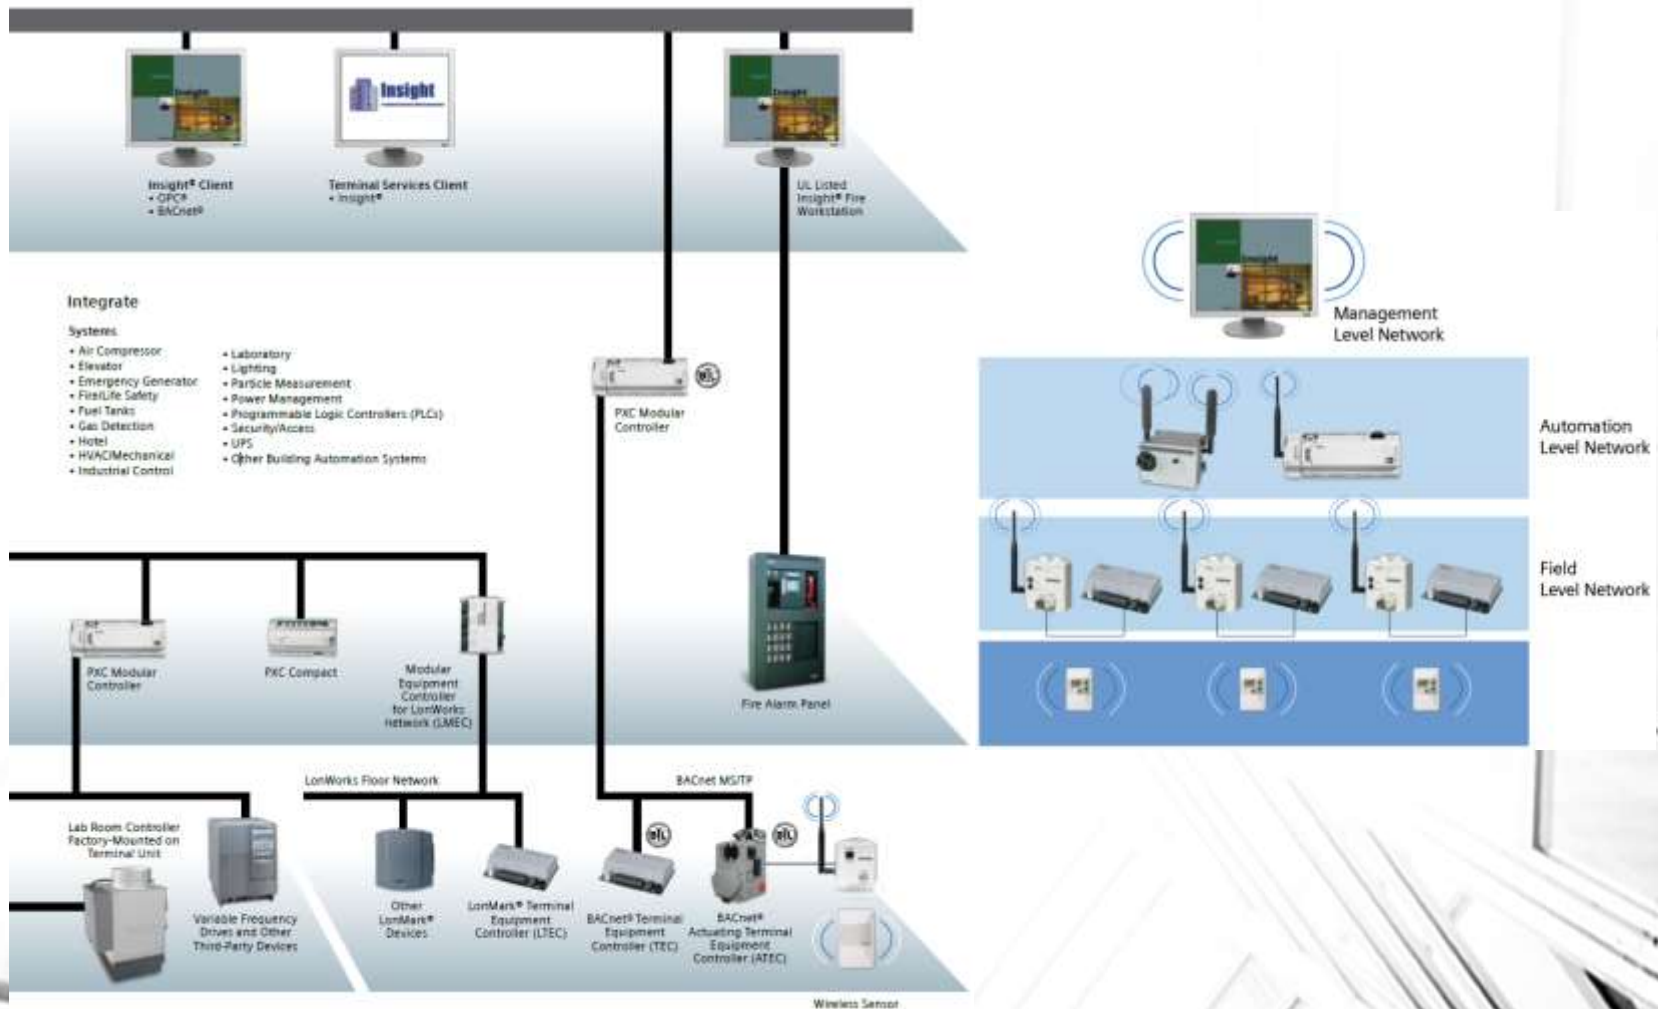


SWOT ANALYSIS OF BMS ARCHITECTURE

(The SWOT analysis is a strategic planning method used to evaluate the Strengths, Weaknesses, Opportunities, and Threats of elements or strategies)

Architecture	Costs	Flexibility	Easy to install	Mixing with BMS	Visual performance and comfort	Standby zero supports
Plant Control	Intermediate	Intermediate	Easy	Possible	Low	No
Zone Control	Intermediate	Intermediate	Low	Easy easy	Intermediate	No
Wiring Device Control	Low	Low	Easy	Difficult	Intermediate	No
Embedded Fixture Control	High	High	No expert is needed	Easy	High	NO
Fides-BMS	Very low	Very high	Quite easy	Quite easy	Very High	Yes


FIDES-BMS system are No wire, No switch with absolute standby zero supports.

FIDES dimming wire connection

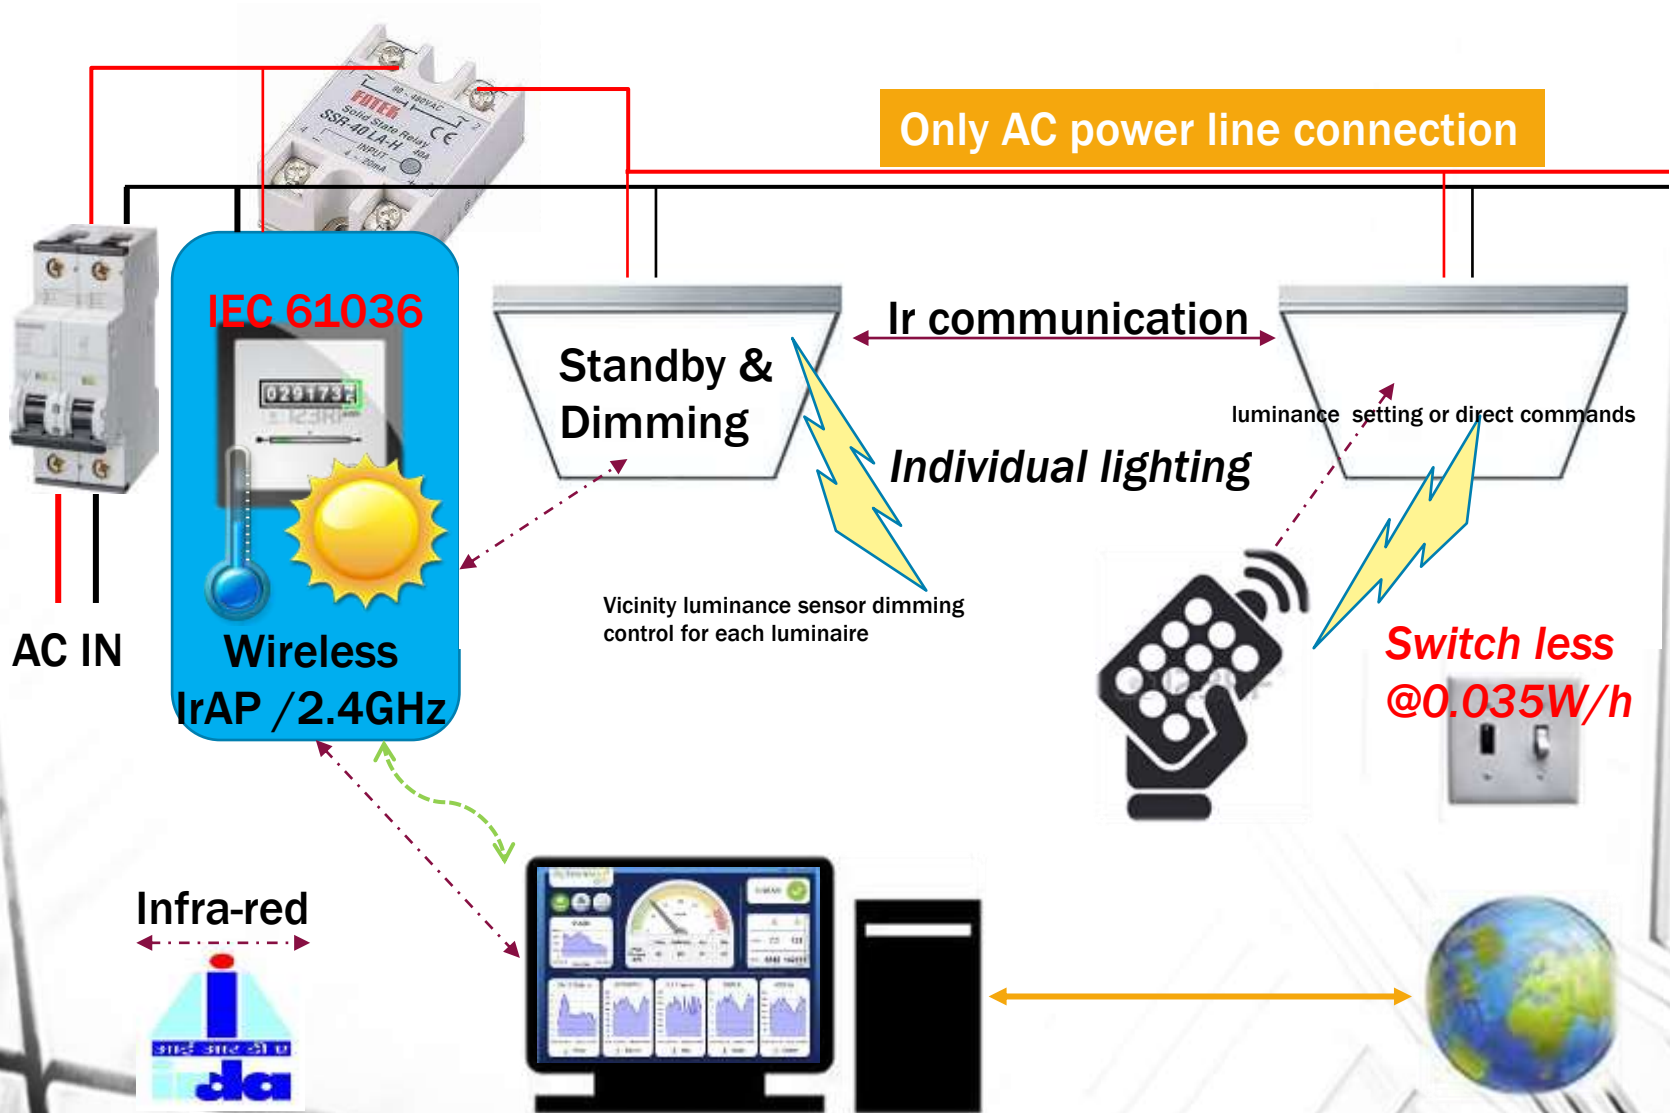


FIDES LUMINAIRE

More information refer to FIDES-ADSZ datasheet

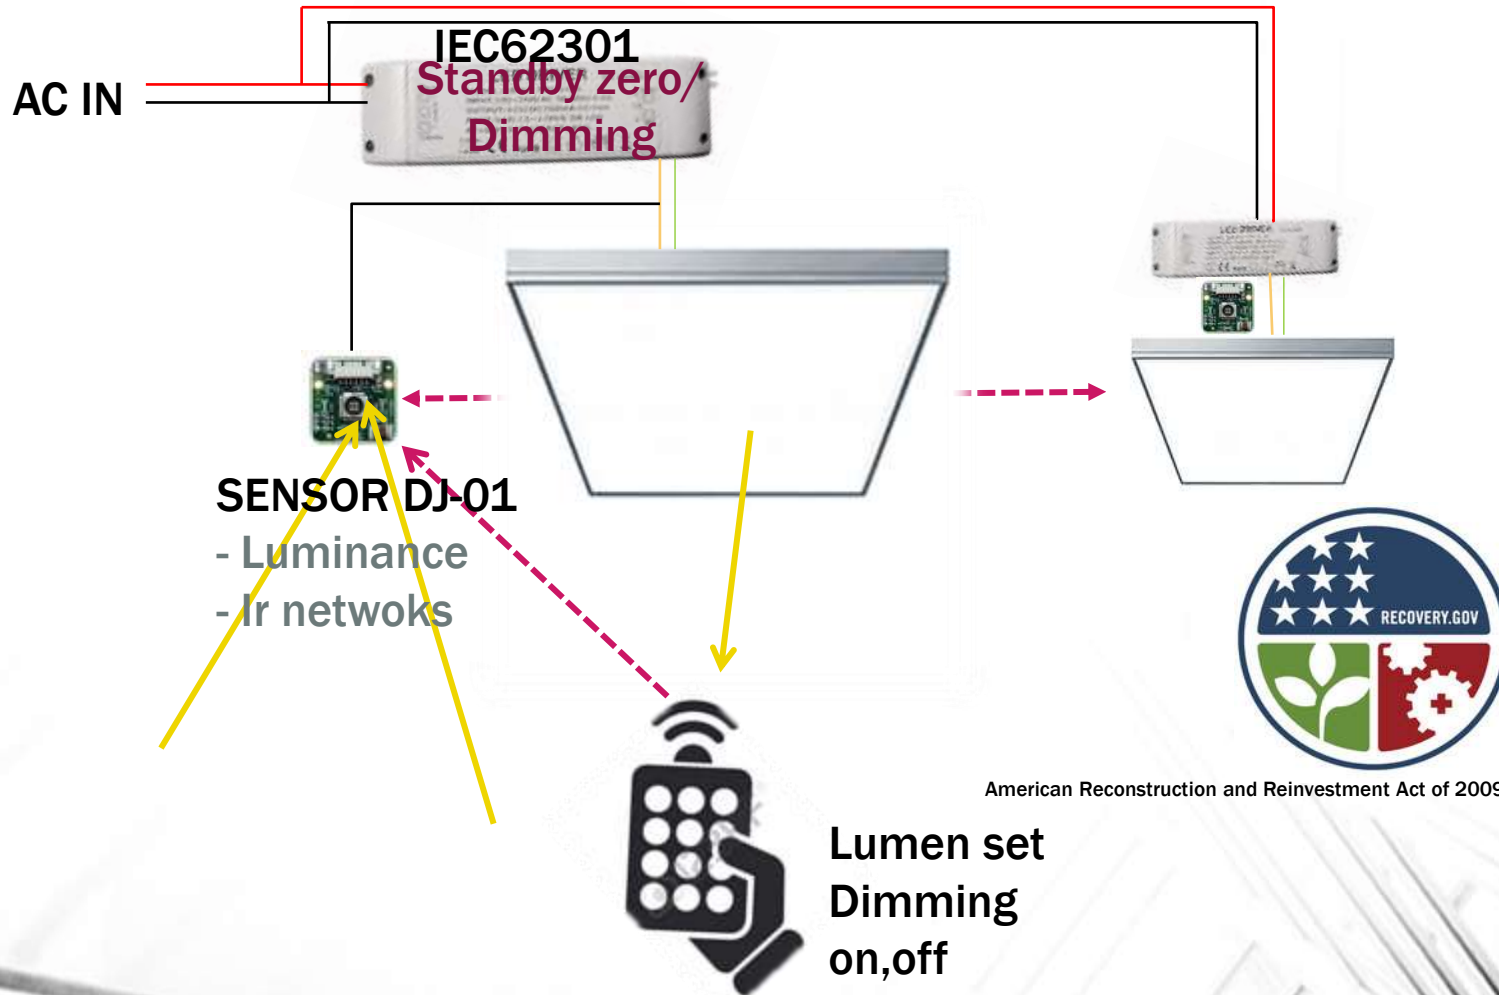

American Reconstruction and Reinvestment Act of 2009

FIDES-BMS WIRE SYSTEM ONLY ONE AC LINE

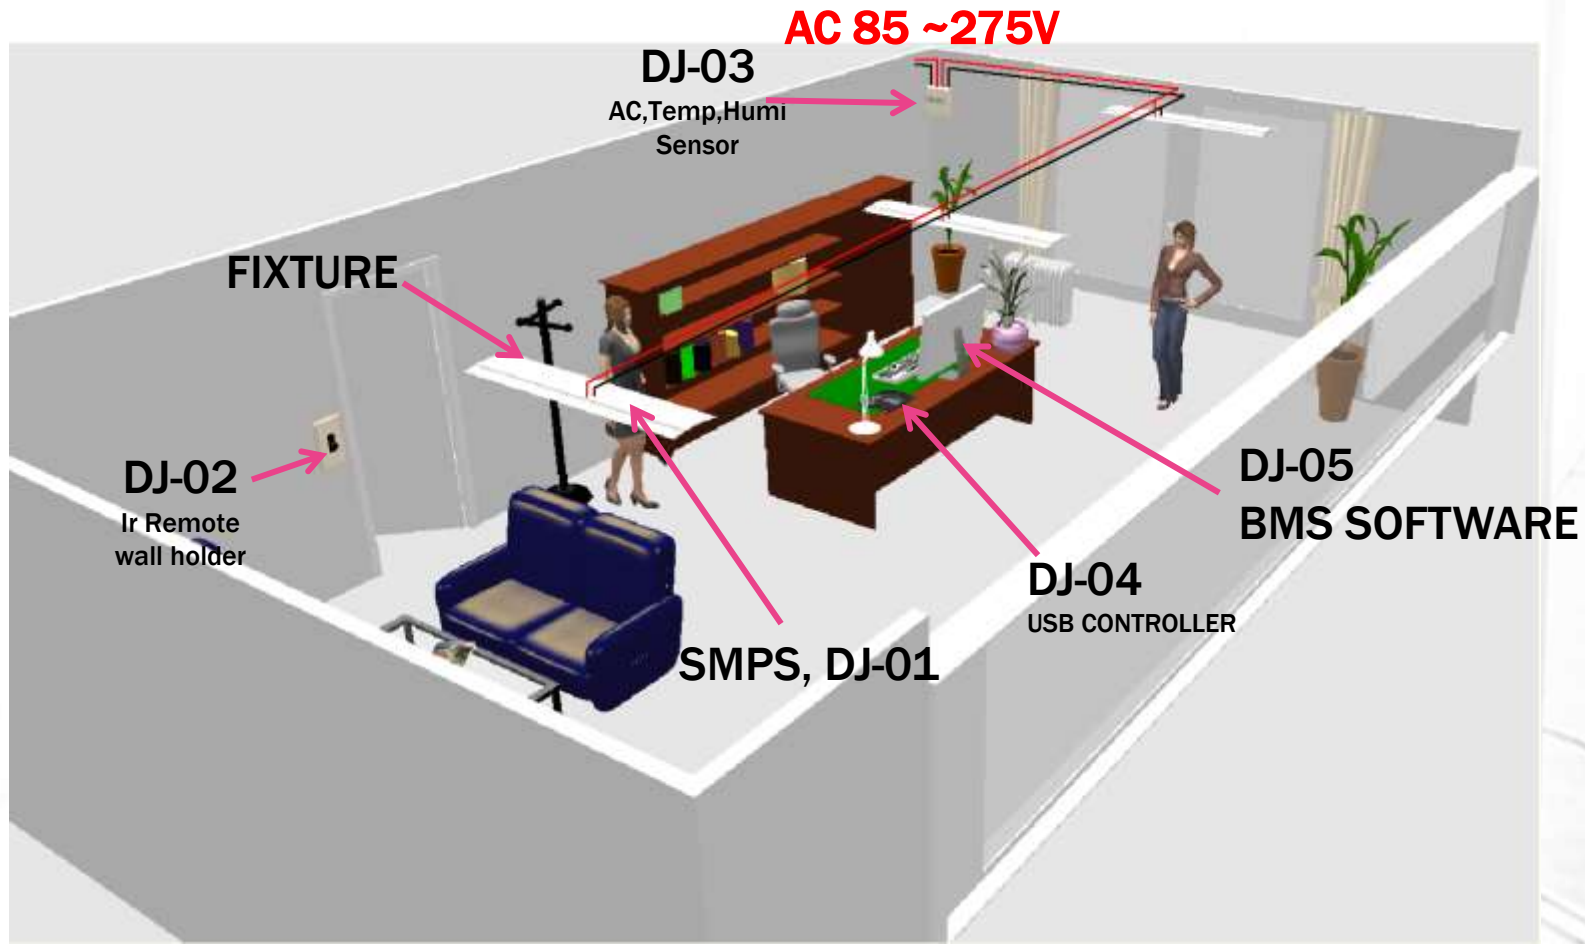

FIDES LIGHTING BMS SYSTEM CONNECTS ALL JUST ONE AC WIRE



No Switch!, No Sensor cable!, No Controller!, No Gateway!


ONLY AC LINE WIRING!!!

As same for One Room to Whole Building


FIDES-AP BM PLACEMENTS

◆ DJ03A: place to each rooms Functions :


- AC shutdown Switching
- Individual dimming
- Room Temperature
- Room Humidity
- Room Ambient
- Room Electric power consumption measurement
- Wireless network

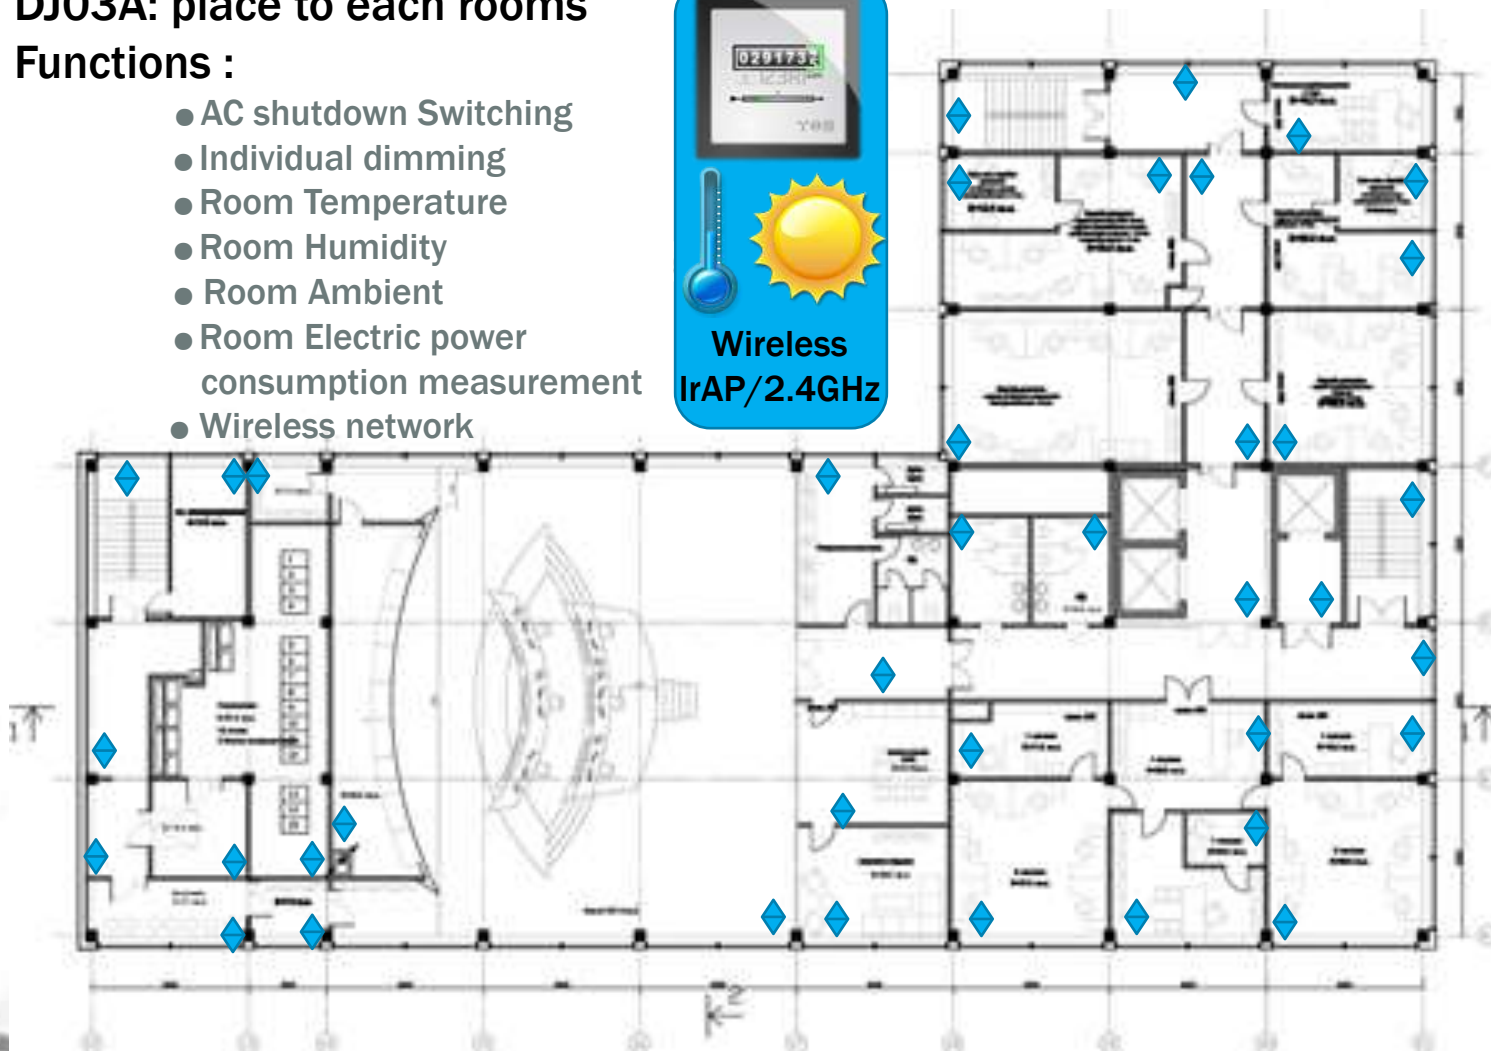


(주) 다재기술



DJ-03A WIRING

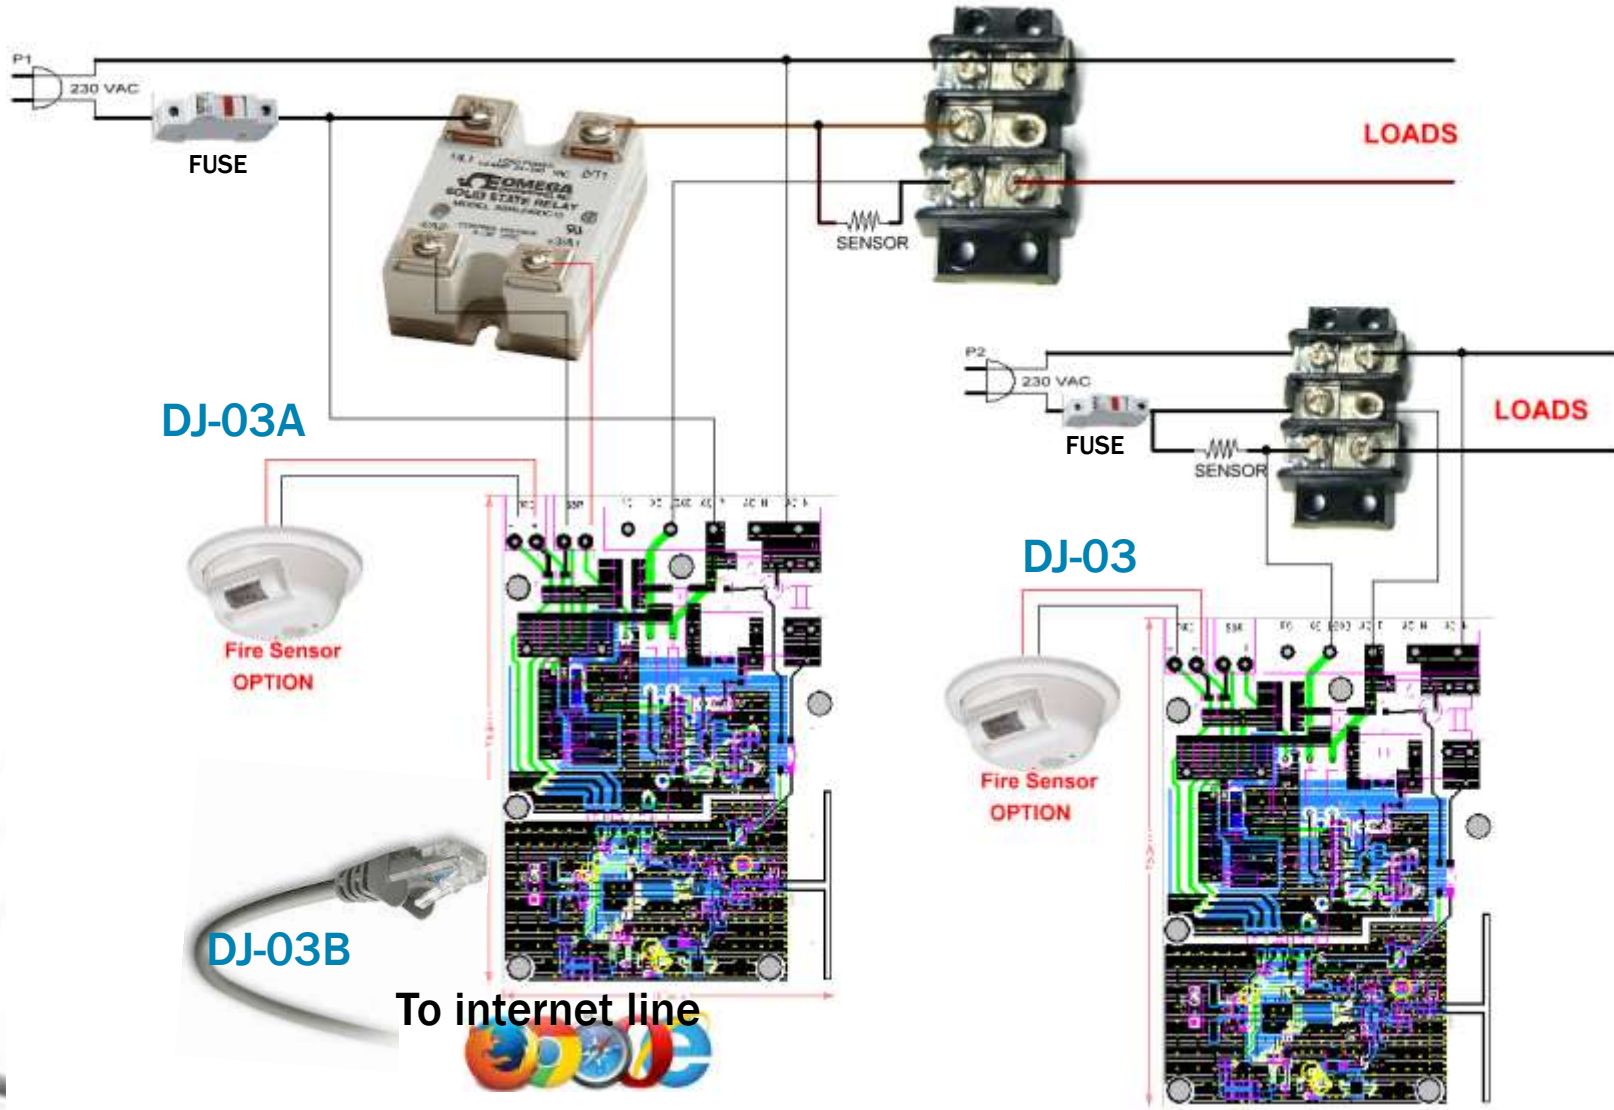

PRODUCTS

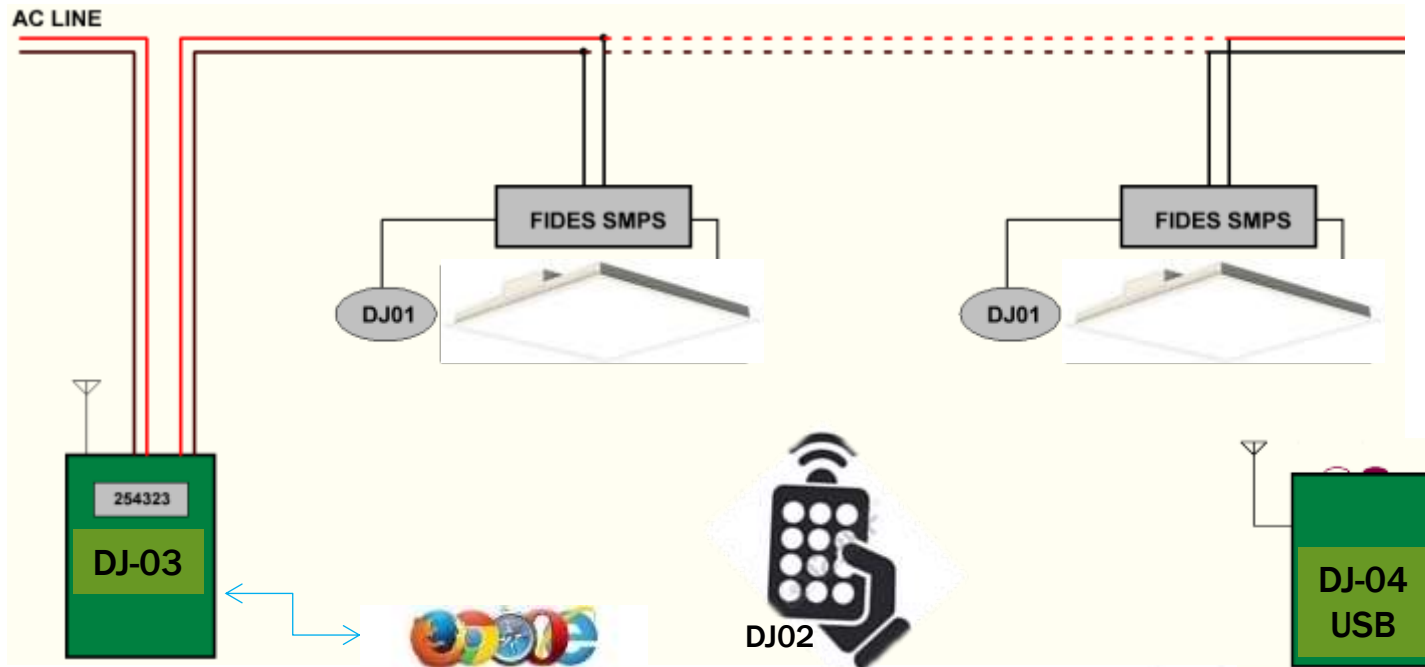

FIDES SMPS : AC-DC SMPS for IEC62301 Standby Zero, Dimming

DJ-01 : IrDA, Luminance sensor (Pair with FIDES SMPS)

DJ-02 : Remote controller

DJ-03 : Access Point 2.4Ghz and IrDA with IEC62036 Class II AC Power smart meter, Temp, Humidity, ambient sensor (AC85~275V 50/60Hz), Remote Shutdown SW(DJ-03A) (*1BMS OPTION*), *Direct WEB Server(DJ-03B)*


DJ-04 : USB Access Point Main Controller (*BMS OPTION*)

DJ-05 : FIDES-BMS Software (*BMS OPTION*)

* *1BMS* are supports multi rooms and environments measure

PRODUCTS OPTION : DJ-01E

Emergency lighting option are full power lighting service 3h at blackout

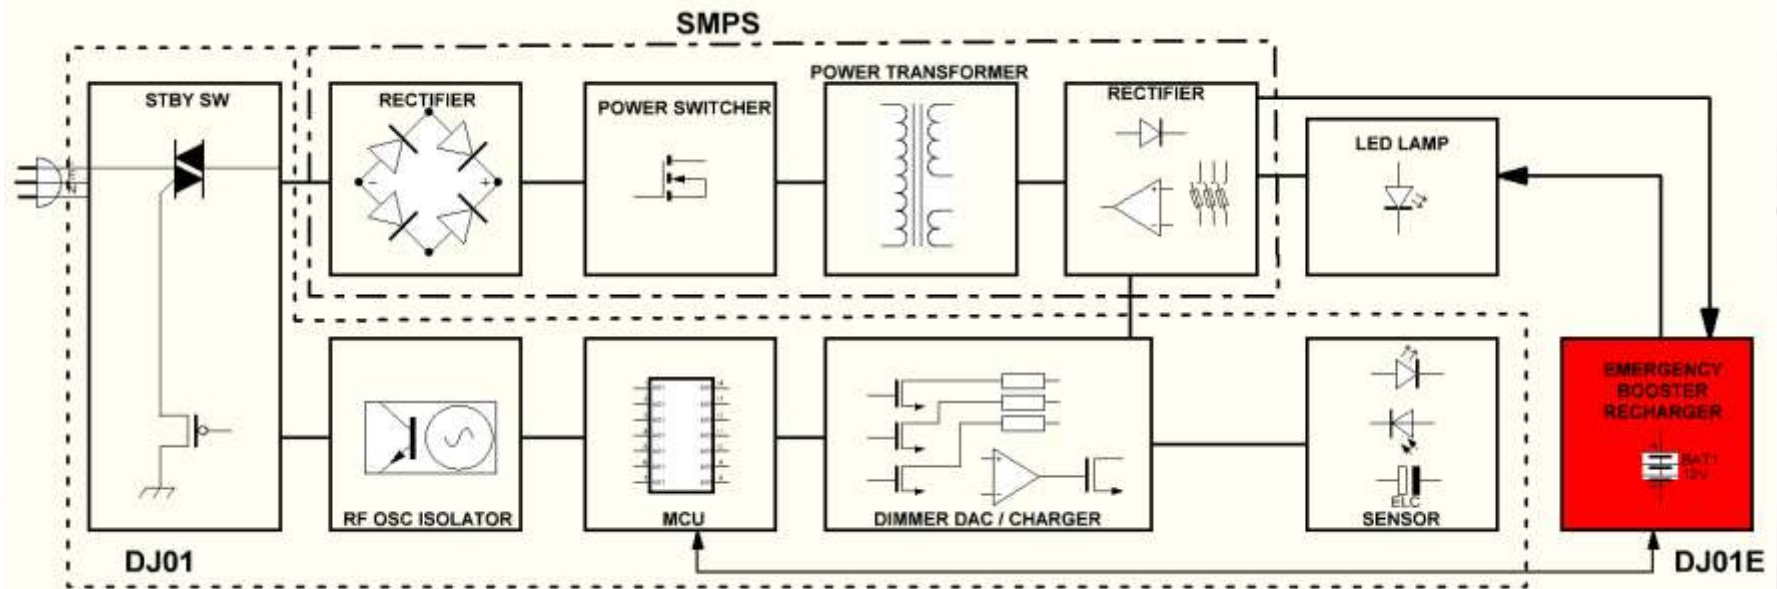


When a blackout, DJ01E are sustained 3h for full power lighting or half power for 6h more illuminate a luminaire by internal battery.



It's very useful at stoped electric service and electric problems.

The re-chargerble battery are automatically charged with status anounce and remote controled by DJ02, DJ05.



FIDES- BMS PRODUCTS

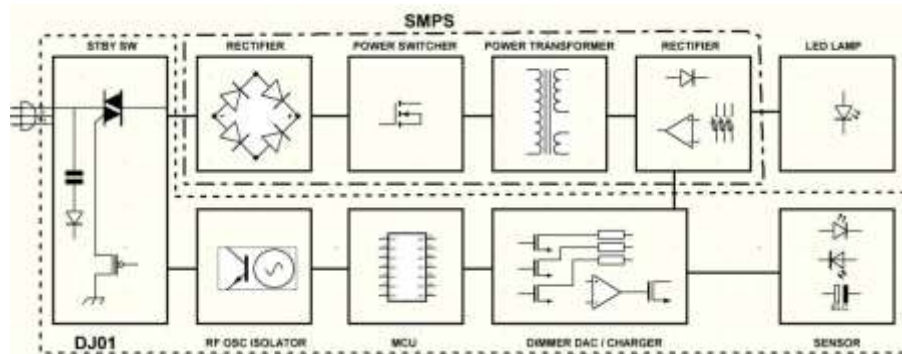

DJ-01

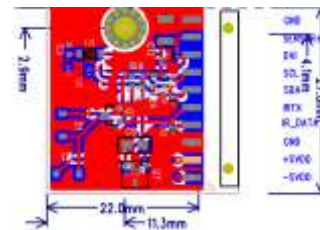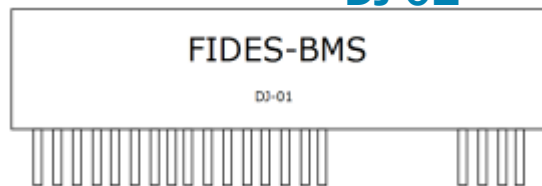

DJ-02

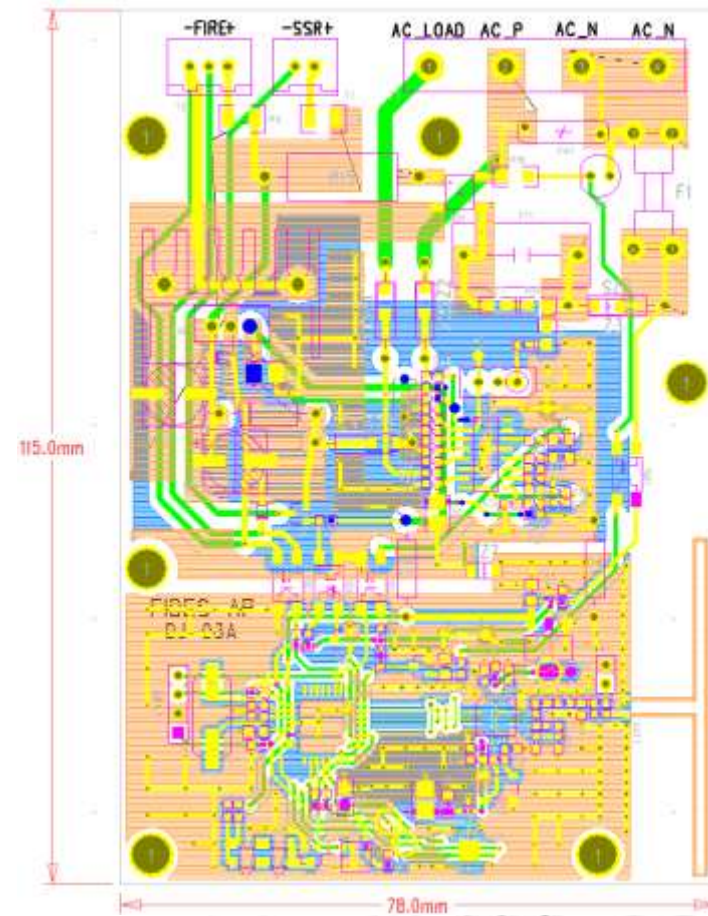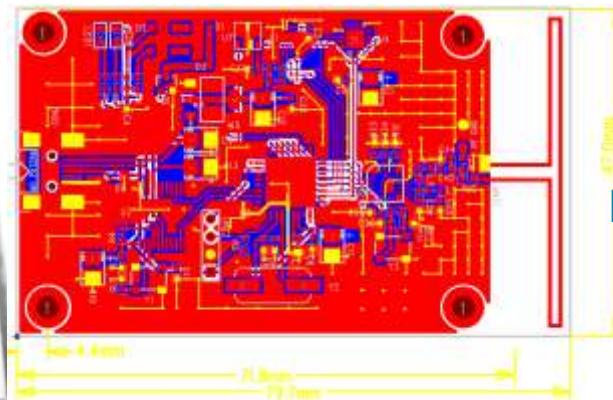

DJ-03A

FIDES-BMS

DJ05 BMS SYSTEM
MANAGEMENT SOFTWARE

初期画面



FIDES BMS 管理者LOGIN

使用者
モード

ID : x x x x x x x x (8桁)

PASSWORD : x x x x x x x x
(8桁)

管理者**LOGIN** モードはサーバーを管理する権

MAIN CONTROL

FIDES-BMS

AP 1

AP 1

AP 1

AP 1

AP 1

AP 1

AP 1

AP 1

AP 1

AP 1



BMS POWER SWITCH

DAJAE TECH. Co,ltd

選択されたAP内の登

APの履歴管理

AC Power

3045W/h

Ambient

650lx

Temperature

23 °C

Humidity

55%

これはAP内のセンサー値の表示です。



AC line live display


本来は電力会社からの電気が生きているかを表示するものです。

AP ON/OFF SW

戻る

次に

温度、湿度計は強制に読み出しをすれば反応をする。

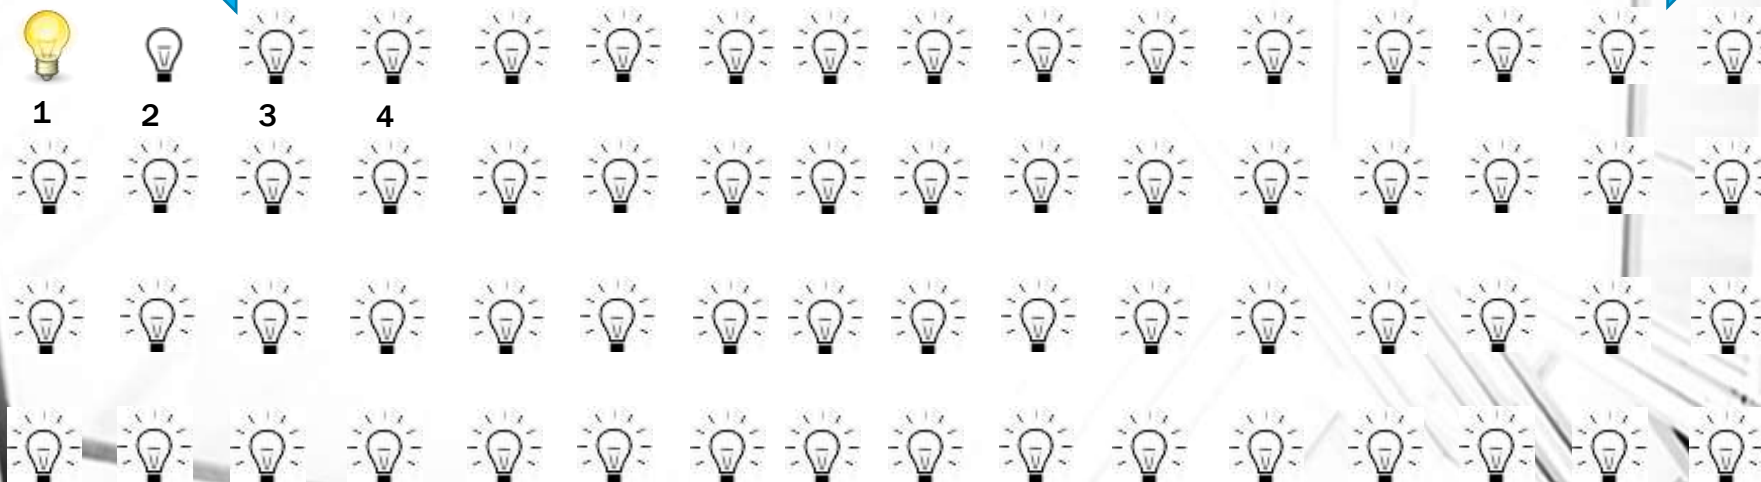

選択されたAP内の登の表示について

表示を**50**個単位で分けてもいいですが、 スクロール処理にする。

1	2	3	4	5	6	7	8	9	10
11	12	13	14	15	16	17	18	19	20
21	22	23	24	25	26	27	28	29	30
31	32	33	34	35	36	37	38	39	40
41	42	43	44	45	46	47	48	49	50
51	52	53	54	55	56	57	58	59	60
61	62	63	64	65	66	67	68	69	70
71	72	73	74	75	76	77	78	79	80
81	82	83	84	85	86	87	88	89	90
91	92	93	94	95	96	97	98	99	100



個別の登器具のコントロール画面(登器具番号も表示)


Buttonやslideは出来ればgraphicで処理したいです



ON/OFF



DIM HALT

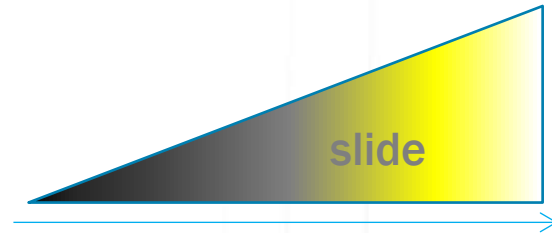

DIMMING (× × %)

現在

LUX 350lx

SET

LUX 570lx


登器具にある照度センサー値とは違い、希望で設定したDIMMING値の表示です

以前に戻る

HOMEに

COOPER LIGHTING

Dimming w/ BMS

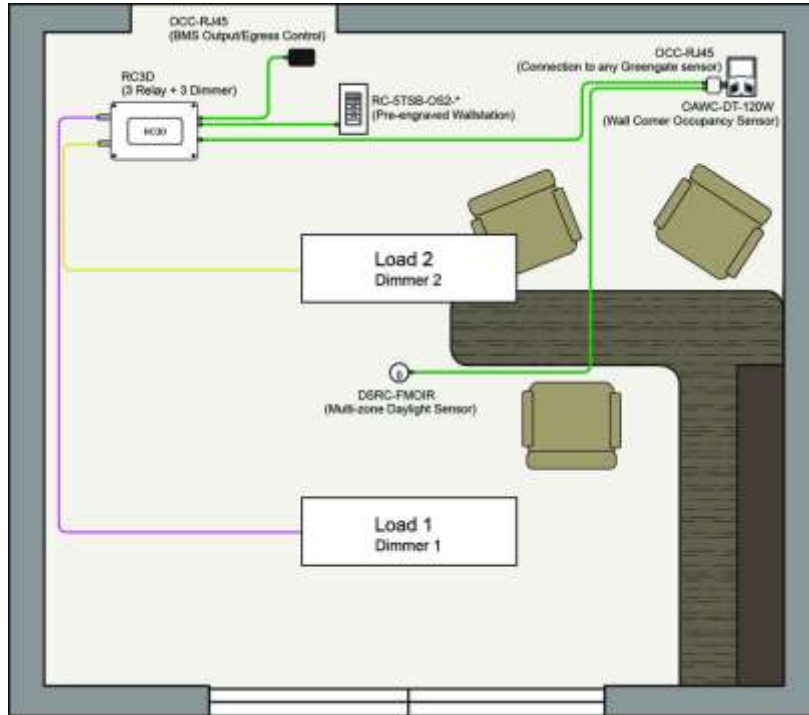

RCQK-OS3E-OS1-SS1-W1-D1-B-W



The Room Controller includes three relays and up to three 0-10 VDC dimming outputs to control compatible dimmable ballasts. The switching relays and 0-10 VDC outputs are controlled separately allowing flexibility in wiring and control. The Room Controller is shipped preconfigured to work out of the box when connected to RC devices allowing quick and easy daylighting controls, occupancy/vacancy sensing and manual switching. Eliminate wiring errors and reduce installation time with Click & Go technology. Benefit from advanced features like UL 924, BMS integration, Egress and Demand Response while meeting energy codes. Single package QuickKit makes the Room Controller simple to specify, install and use.



Daylight Sensor



Occupancy Sensors




Switchpack





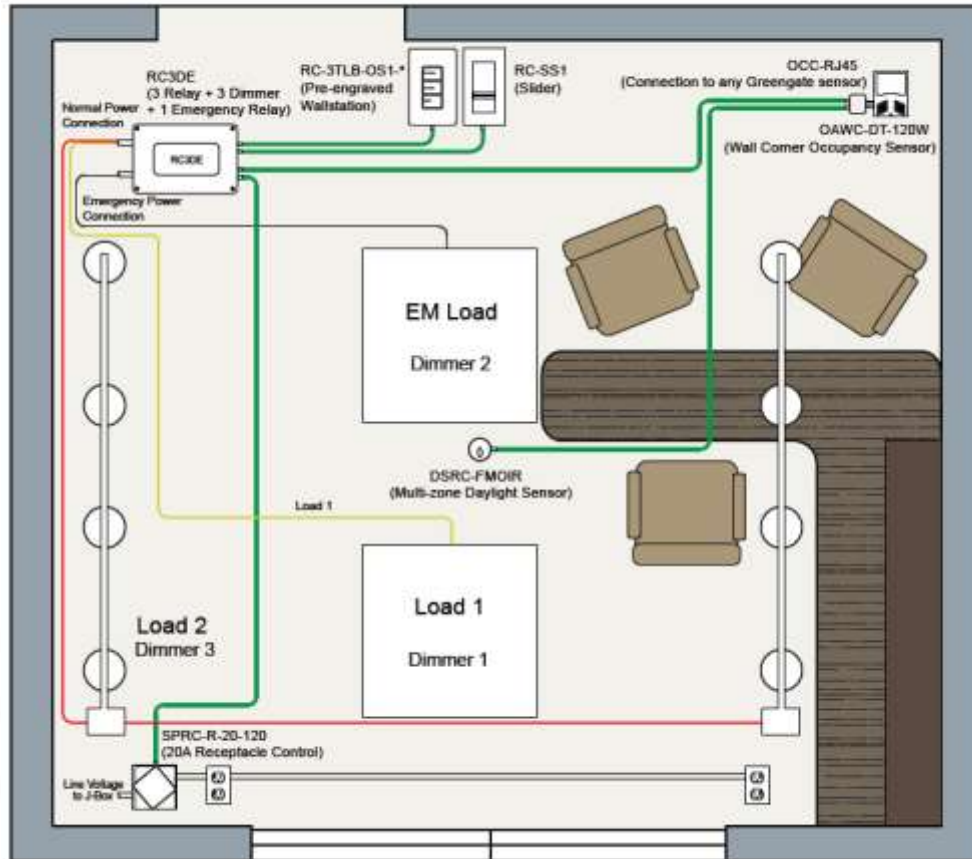

COOPER LIGHTING

Room Controller QuickKit RCQK-OS3E-OS1-SS1-W1-D1-P-W



Product Legend


-  **QTY1: RC3DE**
3 RELAY + 3 DIMMER + 1 EMERGENCY RELAY
 -  **QTY1: RC-3TLB-OS1-W**
HALF LIGHTS, FULL LIGHTS, ALL OFF
 -  **QTY:1 RC-SS1-W**
WHITE SLIDER
 -  **QTY1: DSRC-FMOIR**
DAYLIGHT SENSOR
 -  **QTY1: OAWC-DT-120W**
WALL CORNER VACANCY SENSOR
 -  **QTY1: OCC-RJ45**
OCCUPANCY SENSOR RJ45 CONNECTOR
 -  **QTY1: SPRC-R-20-120**
RECEPTACLE CONTROL
 -  **QTY2: GGRJ45-10-G**
QUICKCONNECT CABLE 10'
 -  **QTY3: GGRJ45-25-G**
QUICKCONNECT CABLE 25'
 - SINGLE BOX PACKAGING WITH WIRING DETAIL AND INSTALLATION**
 -  **RECESSED FIXTURE**
- FOR GUARANTEED COMPATIBILITY REFER TO PREFERRED COOPER LIGHTING FIXTURE INFORMATION BELOW.

COOPER LIGHTING

ROOM CONTROLLER SAMPLE ROOM LAYOUT (30' x 30')

Room Controller QuickKit

RCQK-CR3-ES1-TS6-C1-DH-B-W

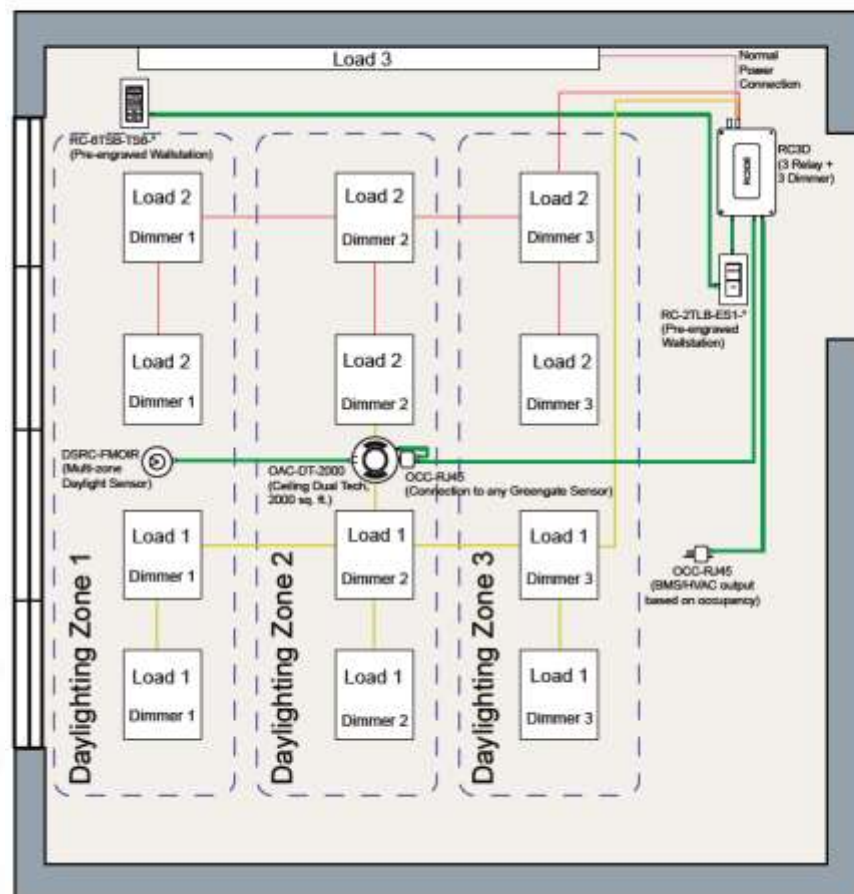

Product Legend


-  **QTY1: RC3D**
3 RELAY + 3 DIMMER
-  **QTY1: RC-2TLB-ES1-W**
(ENTRY, ALL OFF)
-  **QTY1: RC-6TSB-TS6-W**
(ENTRY, GENERAL, WHITEBOARD, RAISE, LOWER, ALL OFF)
-  **QTY1: DSRC-FMOIR**
DAYLIGHT SENSOR
-  **QTY1: OAC-DT-2000**
CEILING MOUNT VACANCY SENSOR 2000 SQ. FT.
-  **QTY2: OCC-RJ45**
OCCUPANCY SENSOR RJ45 CONNECTOR
BMS OUTPUT DEVICE
-  **QTY1: HHPRG-RC**
HANDHELD DAYLIGHT PROGRAMMER
-  **QTY1: GGRJ45-10-G**
QUICKCONNECT CABLE 10'
-  **QTY3: GGRJ45-25-G**
QUICKCONNECT CABLE 25'
-  **QTY1: GGRJ45-50-G**
QUICKCONNECT CABLE 50'
- SINGLE BOX PACKAGING WITH WIRING DETAIL AND INSTALLATION**
-  **RECESSED FIXTURE**

FOR GUARANTEED COMPATIBILITY REFER TO PREFERRED COOPER LIGHTING FIXTURE INFORMATION BELOW.

Target Vendor

- Lighting Type : LED
- Communication Type : IP-Wired, RF wireless, Ir wireless
- Deployments : 1 to unlimited
- Avg. Payback : 12~24Months
- Target market : Residential, Commercial, Industrial
- Partnerships : OEM, Channel

Vendors by Stage & Market Segment

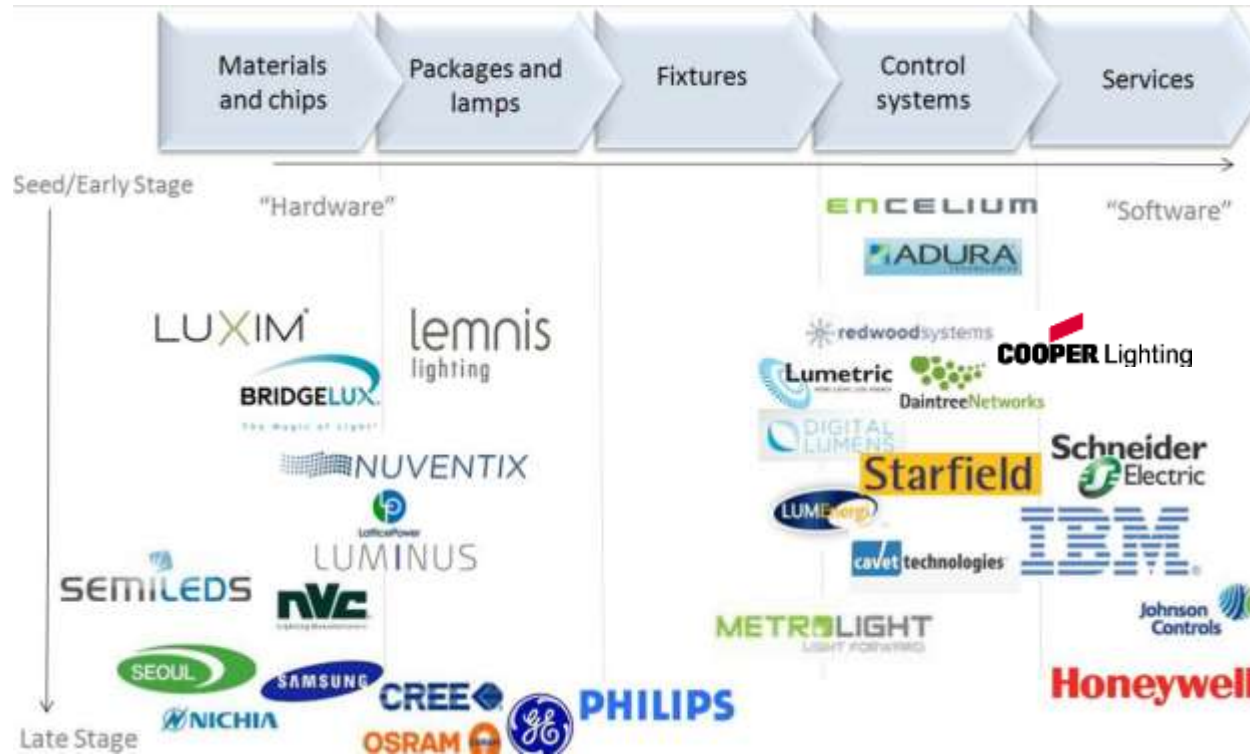

Total Cost of Ownership or Lifetime Cost of Lighting (LCOL)

Lifetime cost = $S1(\text{selling price}) + O\&M + R$ (Replacement costs)

Where: $S1 = \text{ASP}$ - Average selling (or retail) price of a fixture

WORLD BEST FIDES-BMS



Dajae Electronic is one of the largest independent own standby zero patent technology with one stop manufacture of electronics and electrical hardware software in the S.Korea Based in Youngin, Keonggi. Dajae Electronic has 10 distribution facilities in south Korea, serving contractors, original equipment manufacturers (OEM) and the maintenance, repair and operations (MRO) needs of commercial, industrial, institutional and utility customers international wide. We are accept any co-protocols and fixtures product.

Corporate Headquarters

Shipping Address:

Youngin, Keonggi KOREA

Other:

Phone 82-10-3343-0318

Fax 82-31-747-7720